


Heating curve 80/60 °C

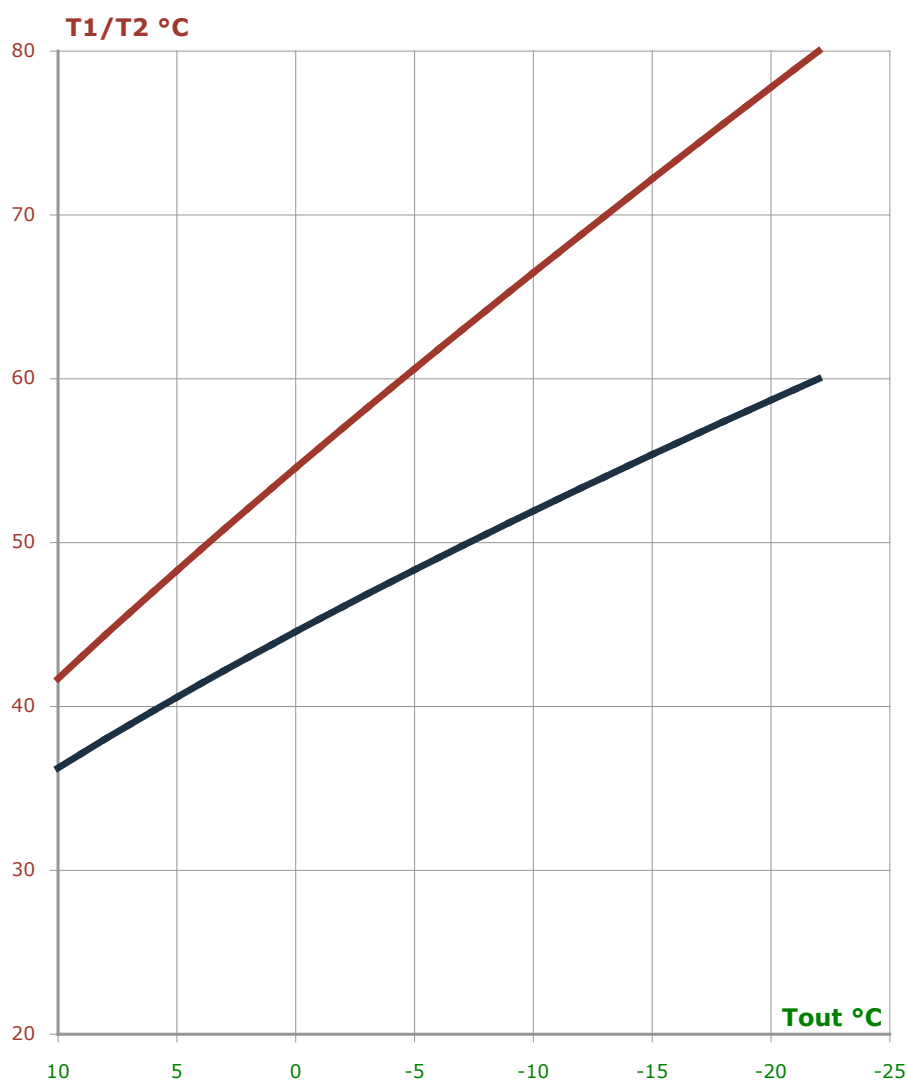

| Tout | T1 | T2 | kW |
|---------------|--------------|--------------|-------------|
| 10 °C | 42 °C | 36 °C | 27% |
| 9 °C | 43 °C | 37 °C | 30% |
| 8 °C | 44 °C | 38 °C | 32% |
| 7 °C | 46 °C | 39 °C | 34% |
| 6 °C | 47 °C | 40 °C | 36% |
| 5 °C | 48 °C | 41 °C | 39% |
| 4 °C | 50 °C | 41 °C | 41% |
| 3 °C | 51 °C | 42 °C | 43% |
| 2 °C | 52 °C | 43 °C | 45% |
| 1 °C | 53 °C | 44 °C | 48% |
| 0 °C | 55 °C | 45 °C | 50% |
| -1 °C | 56 °C | 45 °C | 52% |
| -2 °C | 57 °C | 46 °C | 55% |
| -3 °C | 58 °C | 47 °C | 57% |
| -4 °C | 59 °C | 48 °C | 59% |
| -5 °C | 61 °C | 48 °C | 61% |
| -6 °C | 62 °C | 49 °C | 64% |
| -7 °C | 63 °C | 50 °C | 66% |
| -8 °C | 64 °C | 51 °C | 68% |
| -9 °C | 65 °C | 51 °C | 70% |
| -10 °C | 66 °C | 52 °C | 73% |
| -11 °C | 68 °C | 53 °C | 75% |
| -12 °C | 69 °C | 53 °C | 77% |
| -13 °C | 70 °C | 54 °C | 80% |
| -14 °C | 71 °C | 55 °C | 82% |
| -15 °C | 72 °C | 55 °C | 84% |
| -16 °C | 73 °C | 56 °C | 86% |
| -17 °C | 74 °C | 57 °C | 89% |
| -18 °C | 76 °C | 57 °C | 91% |
| -19 °C | 77 °C | 58 °C | 93% |
| -20 °C | 78 °C | 59 °C | 95% |
| -21 °C | 79 °C | 59 °C | 98% |
| -22 °C | 80 °C | 60 °C | 100% |

T1 - water temperature at the entrance to the heating system, °C

T2 - water temperature at the exit from the heating system, °C

Tout - outdoor temperature, °C

kW - share of the heat load of the heating system from the calculated design value, %