

CATALOGUE THERMOHYDRAULICS

STORAGE
HEATING
COOLING
SOLAR

BLADDER AUTOCLAVES FOR SANITARY WATER

MULTI-FUNCTIONAL TANKS

EXPANSION TANKS FOR HEATING

TANKS FOR SOLAR SYSTEMS

PLASTO - POLYETHYLENE STORAGE TANKS
FOR ABOVE GROUND

PLASTO - POLYETHYLENE STORAGE TANKS
FOR UNDERGROUND & WASTEWATER TREATMENT

GALVANIZED/GLASSLINED TANKS

HOT WATER TANKS


ASME TANKS



APPLICATIONS


GLASSLINED CYLINDER FOR HEAT PUMP

BSP

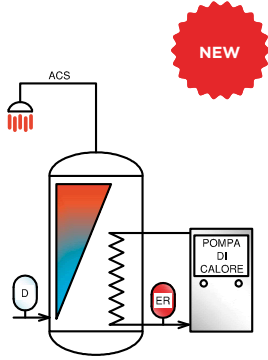


THERMAL FLYWHEEL WITH SINGLE HEAT EXCHANGER

PUFFER S1

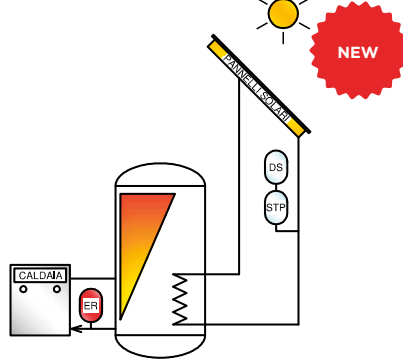


THERMAL FLYWHEEL WITH 2 HEAT EXCHANGERS

PUFFER S2

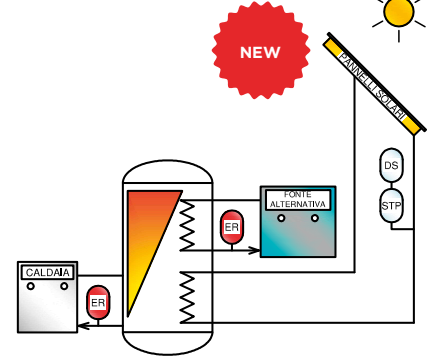


COMBI

CMS - STANDARD

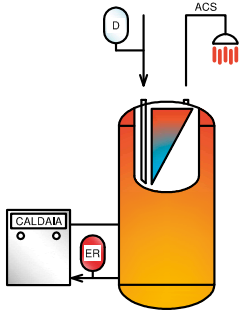


CMP - PLUS

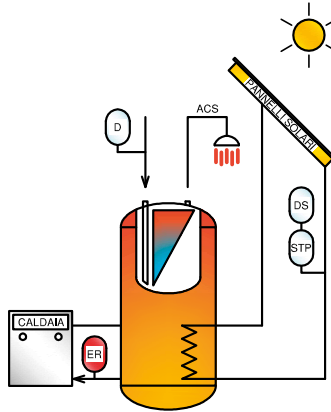


DHW CYLINDER WITH 2 HEAT EXCHANGERS

BST / BXT / BF-2 / BG

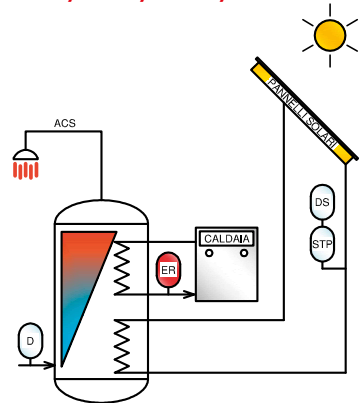


DHW CYLINDER WITH 1 HEAT EXCHANGER

BSH HORIZONTAL

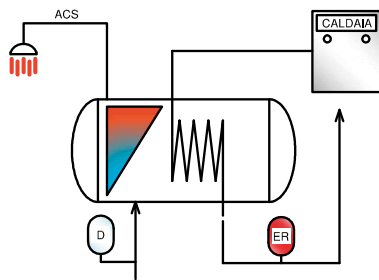


BSV / BSM / BXV / BF-1 / BG




DHW CYLINDER WITH 3 HEAT EXCHANGERS

BF-3 / BG

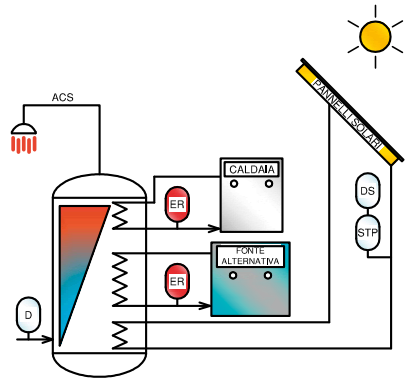


COMBI QUICK


CQS - STANDARD

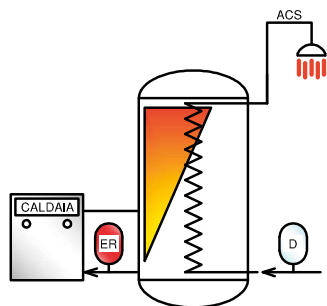

CQP - PLUS

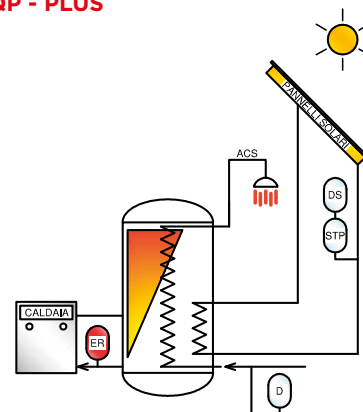

CQT - TWIN

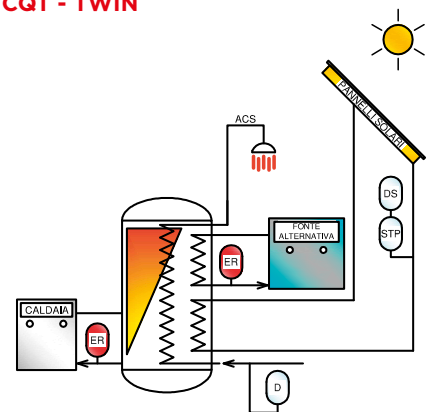




BF1

GLASSLINED CYLINDERS

WITH REMOVABLE STAINLESS STEEL HEAT EXCHANGER (1.500 - 5.000 LITRES)



BF1 1500 - 2000 - 3000 - 5000

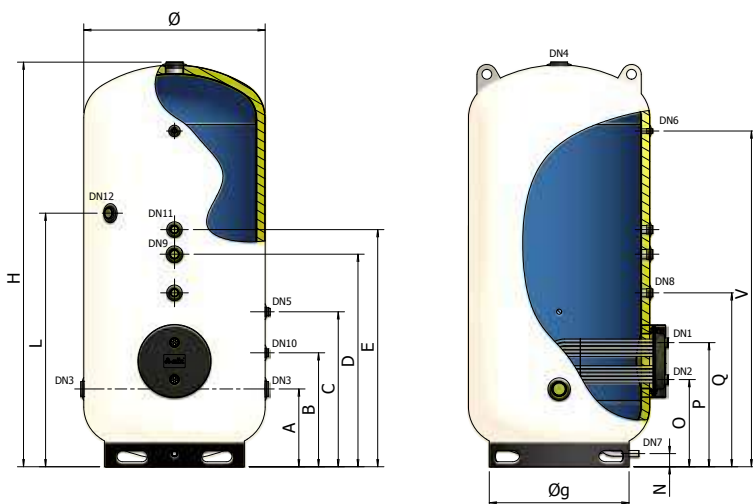

KEYWORD

DN1: Primary fluid inlet (heat exchanger side); **DN2:** Primary fluid outlet (heating side); **DN3:** Sanitary cold water inlet; **DN4:** Sanitary hot water outlet; **DN5:** Magnesium anode; **DN6:** Probes (Thermometer, Thermostat); **DN7:** Tank drain; **DN8:** Thermo-regulation; **DN9:** Recirculation; **DN10:** Sanitary expansion tank; **DN11:** Extra optional Magnesium Anode; **DN12:** Extra optional heating element;

CYLINDER

FOR SANITARY HOT WATER

SUITABLE FOR SOLAR SYSTEMS

INTERNAL, GLASSLINING ANTI-CORROSION TREATMENT

POLYURETHANE INSULATION

HEAT EXCHANGER IN STAINLESS STEEL AISI 304

HANDLING BY FORKLIFT

+ 95°C WORKING TEMPERATURE

+110°C HEAT EXCHANGER MAX TEMPERATURE

P_{MAX} 6 bar MAX WORKING PRESSURE

P_{SCA} 12 bar HEAT EXCHANGER MAX PRESSURE

WARRANTY: 5 YEARS

REFERENCE STANDARDS CYLINDER:

2014/68/UE Directive - ART. 4.3, without CE marking
Ecodesign 2009/125/EC

INTERNAL GLASSLINING:

DIN 4753

The glasslining treatment makes the cylinder suitable to contain hot water for sanitary and hygienic use and resistant to corrosive phenomena.

INSULATION:

Expanded, flexible polyurethane with open cells.

HEAT EXCHANGER:

Removable U pipe stainless steel heat exchanger.

INSTALLATION:

- traditional boilers (wall-hung and/or floor-standing)
- condensing boilers
- solar thermal systems

MODEL	CODE	LOWER HEAT EXCHANGER					NOTES
		LITRES	m ²	LITRES	mm	mm	
BF-1 / 1500	A340H67 VW050	1500	3,00	15	1100	2465	
BF-1 / 2000	A340H70 VW050	2000	4,00	18	1200	2445	
BF-1 / 3000	A340H74 VW050	3000	6,00	24	1350	2840	
BF-1 / 5000	A340H80 VW050	5000	10,00	39	1700	2990	

MODEL	ANODE ø x ø conn. x L	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN
		1	2	3	4	5	6	7	8	9	10	11	12
BF-1 / 1500	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	1.1/4"	1.1/2"	1.1/4"	1.1/4"	2"
BF-1 / 2000	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	1.1/4"	1.1/2"	1.1/4"	1.1/4"	2"
BF-1 / 3000	32 x 1.1/4" x 700	1.1/2"	1.1/2"	3"	3"	1.1/4"	1/2"	1"	1.1/4"	1.1/2"	1.1/4"	1.1/4"	2"
BF-1 / 5000	40 x 1.1/2" x 640	1.1/2"	1.1/2"	3"	3"	1.1/2"	1/2"	1"	1.1/4"	1.1/2"	1.1/4"	1.1/2"	2"

MODEL	A	B	C	D	E	F	G	I	L	M	N	O	P	Q	R	S	T	U	V
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
BF-1 / 1500	475	695	945	1295	1445	-	-	-	1545	-	80	530	755	1060	-	-	-	-	2045
BF-1 / 2000	465	685	935	1285	1435	-	-	-	1535	-	80	520	745	1050	-	-	-	-	2035
BF-1 / 3000	530	730	980	1480	1630	-	-	-	1730	-	80	565	790	1095	-	-	-	-	2380
BF-1 / 5000	635	835	1085	1585	1735	-	-	-	1835	-	80	670	895	1200	-	-	-	-	2485

TECHNICAL CHARACTERISTICS

HEAT EXCHANGER	CODE	MAXIMUM WORKING PRESSURE / MAXIMUM WORKING TEMPERATURE			PRESSURE DROP OF HEAT EXCHANGERS
		HOT WATER 12 BAR / 110 °C	SATURATED STEAM 1 BAR / 120 °C	SATURATED STEAM 2 BAR / 134 °C	
3,0 m ²	2950300 V0010	•	•	•	200 mBar
4,0 m ²	2950400 V0010	•	•	•	220 mBar
6,0 m ²	2960600 V0010	•	•	•	350 mBar
10,0 m ²	2961000 V0010	•	•	n.a.	400 mBar

N.B. If using the heat exchanger with temperatures over 100 °C, ask for steam seals

MODEL	INSULATION TYPE	INSULATION THICKNESS	INSULATION DENSITY	INITIAL THERMAL CONDUCTIVITY	(*) INSULATION THERMAL LOSS	EXTERNAL FINISH
BF-1 / 1500	Flexible expanded polyurethane with open cells	50 mm	15 kg/m ³	39,0 mW/m K	9,969 kWh / 24h	Skay white RAL 9001
BF-1 / 2000					10,865 kWh / 24h	
BF-1 / 3000					13,799 kWh / 24h	
BF-1 / 5000					18,264 kWh / 24h	

(*) Thermal loss calculated with an accumulation temperature equal to 65 °C and with an external temperature equal to 20 °C.

SAFETY DEVICES

The cylinders must be protected against the effects of over pressure by installing:

- A **SAFETY VALVE** calibrated to pressure below the max pressure of the cylinder
- A **SANITARY EXPANSION TANK** mod. ELBI **D - DV series**

MODEL	RECOMMENDED SANITARY EXPANSION TANK (mod. ELBI D-DV series)
BF-1 / 1500	DV - 150
BF-1 / 2000	DV - 150
BF-1 / 3000	DV - 300
BF-1 / 5000	n°2 pcs DV - 200


Sized using the following parameters: T. accumulation= 85 °C / T. inlet = 15 °C / Pre-charge pressure = 3 bar / Max pressure = 6 bar
The recommended capacity must be verified on the basis of the actual dimensions of the system implemented.

MODEL	MAGNESIUM ANODE SUPPLIED	CATHODIC PROTECTION APPLICABLE
BF-1 / 1500	1,1/4" x 670 / Cod.8560070	Cathodic protection for cylinders 1500/2000 l. Code 8560180
BF-1 / 2000	1,1/4" x 670 / Cod.8560070	
BF-1 / 3000	1,1/4" x 700 / Cod.8560080	Cathodic protection for cylinders 3000/5000 l. Code 8560185
BF-1 / 5000	1,1/2" x 640 / Cod.8560100	

ACCUMULATION AT 60 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 60°C

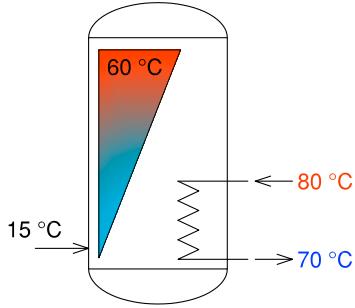

OPERATION WITH HOT WATER

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]	QUANTITY DHW AT 45°C IN FIRST 10 min. ⁽²⁾ [l]
BF-1 / 1500	3,0	72,00	6400	70	1375	1243
BF-1 / 2000	4,0	98,00	8500	63	1828	1594
BF-1 / 3000	6,0	159,30	14100	58	3044	2524
BF-1 / 5000	10,0	250,70	22000	62	4790	4085


(1) Time required to bring the temperature of the cylinder from 15 °C to 60 °C.

(2) Quantity of DHW (Sanitary Hot Water) at 45°C available in the first 10 minutes with DHW accumulation at 60° C.

ACCUMULATION AT 45 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 45°C

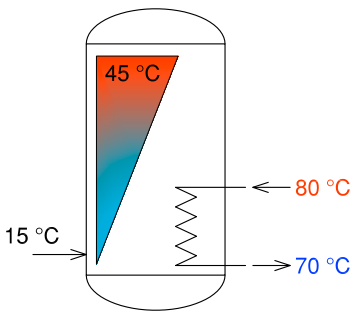

OPERATION WITH HOT WATER


MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 45°C [l/hour]
BF-1 / 1500	3,0	92,00	8100	37	2635
BF-1 / 2000	4,0	131,60	11600	31	3770
BF-1 / 3000	6,0	223,60	19710	28	6410
BF-1 / 5000	10,0	339,00	29900	31	9720

1) Time required to bring the temperature of the cylinder from 15 °C to 45 °C.

ACCUMULATION AT 60 °C

HEAT EXCHANGER: T.inlet = 120°C (1 bar)

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 60°C

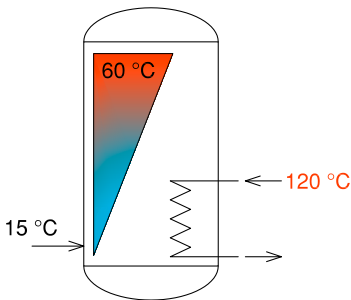

OPERATION WITH STEAM

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]	QUANTITY DHW AT 45°C IN FIRST 10 min.
BF-1 / 1500	3,0	236,00	400	21	4600	2070
BF-1 / 2000	4,0	287,00	486	22	5575	2470
BF-1 / 3000	6,0	440,30	754	21	8400	3820
BF-1 / 5000	10,0	675,70	1143	23	12890	6020


(1) Time required to bring the temperature of the cylinder from 15 °C to 60 °C.

(2) Quantity of DHW (Sanitary Hot Water) at 45°C available in the first 10 minutes with DHW accumulation at 60° C.

ACCUMULATION AT 45 °C

HEAT EXCHANGER: T.inlet = 120°C (1 Bar)

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 45°C

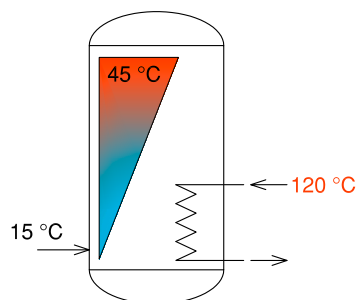

OPERATION WITH STEAM


MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]
BF-1 / 1500	3,0	265,60	450	13	7615
BF-1 / 2000	4,0	315,70	534	14	9048
BF-1 / 3000	6,0	495,00	839	13	14185
BF-1 / 5000	10,0	745,00	1263	14	21350

(1) Time required to bring the temperature of the cylinder from 15 °C to 45 °C.

ACCUMULATION AT 60 °C

HEAT EXCHANGER: T.inlet = 134°C (2 bar)

STORAGE WATER HEATER: T.inlet = 15°C; T. accumulation = 60°C

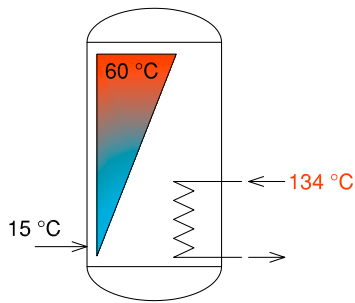

OPERATION WITH STEAM

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]	Quantity DHW AT 45°C in first 10 min ⁽²⁾ [l]
BF-1 / 1500	3,0	278,00	479	19	5310	5310
BF-1 / 2000	4,0	338,00	583	18	6458	6458
BF-1 / 3000	6,0	525,00	905	18	10030	10030
BF-1 / 5000	10,0	790,00	1362	20	15095	15095


(1) Time required to bring the temperature of the cylinder from 15 °C to 60 °C.

(2) Quantity of DHW (Sanitary Hot Water) at 45°C available in the first 10 minutes with DHW accumulation at 60° C.

ACCUMULATION AT 45 °C

HEAT EXCHANGER: T.inlet = 134°C (2 bar)

STORAGE WATER HEATER: T.inlet = 15°C; T. accumulation = 45°C

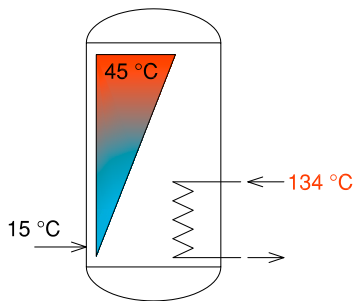

OPERATION WITH STEAM

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 45°C [l/hour]
BF-1 / 1500	3,0	306,30	528	11	8780
BF-1 / 2000	4,0	369,20	636	11	10580
BF-1 / 3000	6,0	645,00	1112	10	18485
BF-1 / 5000	10,0	820,00	1415	13	23500


(1) Time required to bring the temperature of the cylinder from 15 °C to 45 °C.

TABLE OF HEATING ELEMENT APPLICABILITY TO CYLINDERS

Heating element model*					Water heating time from 15° C to 60 °C (expressed in minutes) <i>The heating times outlined are approximate</i>			
CODE	Power (kW)	Voltage (Volt)	Connection	Length (mm)	BF-1 1500	BF-1 2000	BF-1 3000	BF-1 5000
8601000	1	220 V / MF	G 1.1/4"	295	4720 min.	6300 min.	9420 min.	15750 min.
8601650	1.65	220 V / MF	G 1.1/4"	450	2870 min.	3820 min.	5740 min.	9550 min.
8602000	2	220 V / MF	G 1.1/4"	515	2370 min.	3150 min.	4740 min.	7875 min.
8602600	2.6	220 V / MF	G 1.1/4"	675	1830 min.	2450 min.	3660 min.	6125 min.
8602601	2.6	220 V / MF	G 1.1/4"	360	1830 min.	2450 min.	3660 min.	6125 min.
8603300	3.3	220 V / MF	G 1.1/4"	825	1450 min.	1940 min.	2900 min.	4850 min.
8603301	3.3	220 V / MF	G 1.1/4"	435	1450 min.	1940 min.	2900 min.	4850 min.
8604001	4	220 V / MF	G 1.1/4"	510	1200 min.	1600 min.	2400 min.	4000 min.
8705000	5	380 V / TF	G 1.1/2"	445	950 min.	1300 min.	1900 min.	3250 min.
8706000	6	380 V / TF	G 1.1/2"	510	800 min.	1060 min.	1600 min.	2650 min.
8708000	8	380 V / TF	G 1.1/2"	670	610 min.	800 min.	1220 min.	2000 min.
8710000	10	380 V / TF	G 1.1/2"	820	490 min.	640 min.	980 min.	1600 min.
8712000	12	380 V / TF	G 1.1/2"	970	410 min.	540 min.	820 min.	1350 min.

n.a. =Heating element not applicable

SEE TABLE OF SYMBOLS
IN THE SHUTTER OF THE
COVER

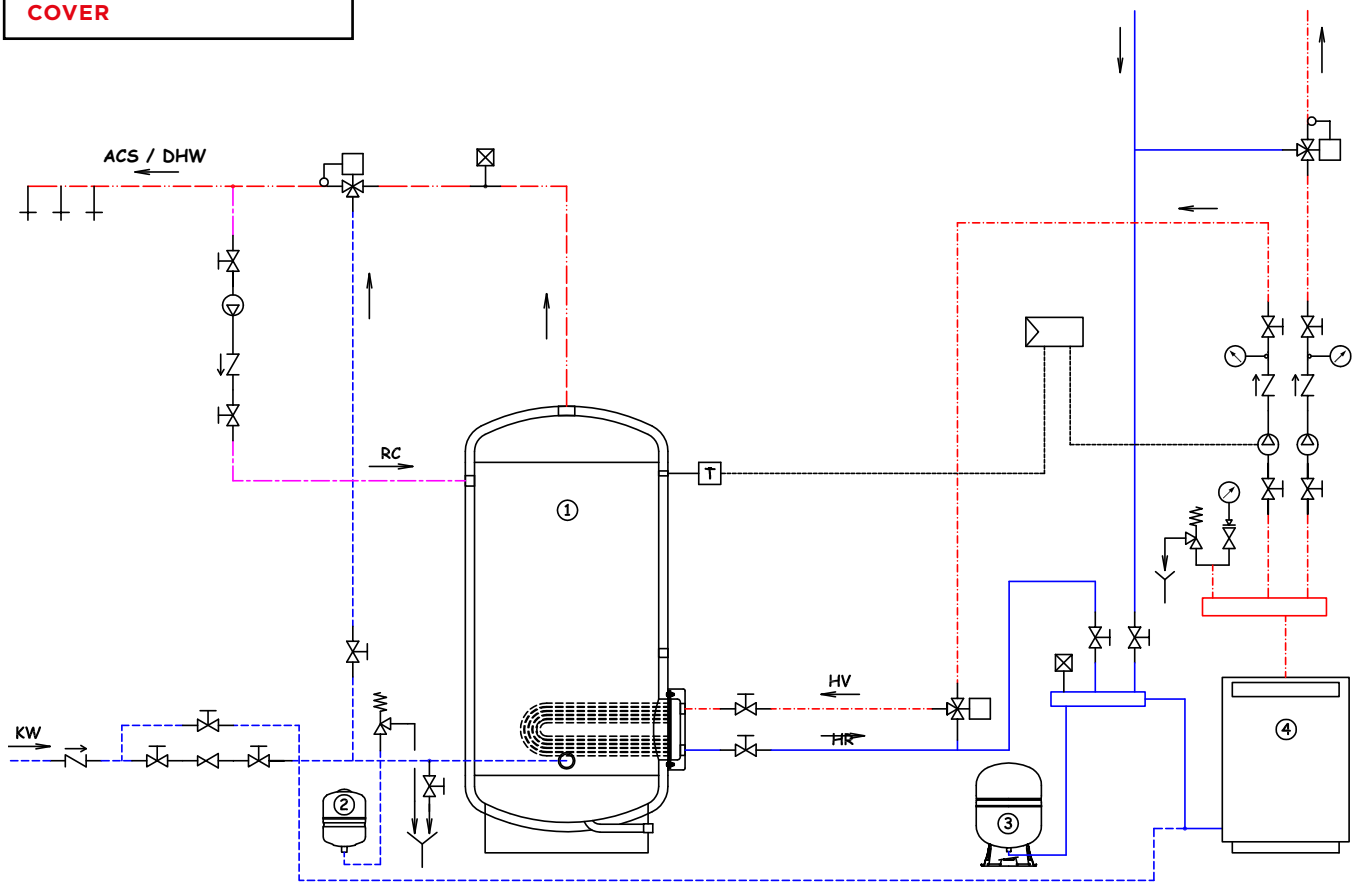





BF2

GLASSLINED CYLINDERS

WITH TWO REMOVABLE STAINLESS STEEL HEAT EXCHANGERS (1.500 - 5.000 LITRES)

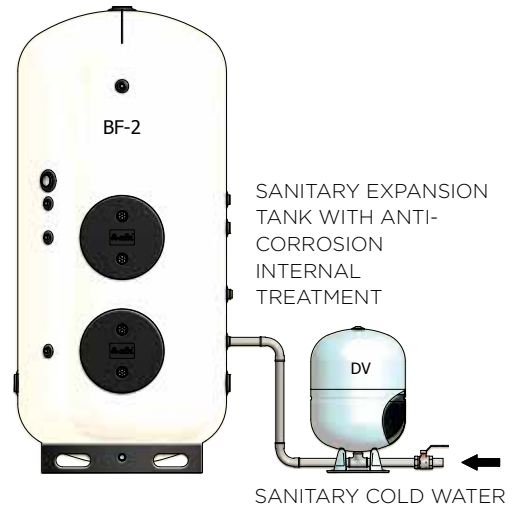

BF2 1500 - 2000 - 3000 - 5000

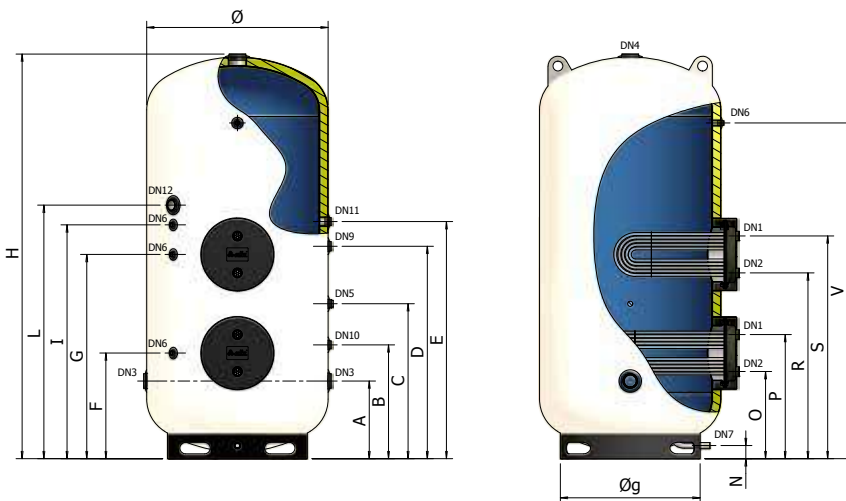

KEYWORD

DN1: Primary fluid inlet (heat exchanger side); **DN2:** Primary fluid outlet (heat exchanger side); **DN3:** Sanitary cold water inlet; **DN4:** Sanitary hot water outlet; **DN5:** Magnesium anode; **DN6:** Probe; **DN7:** Tank drain; **DN8:** Thermo-regulation; **DN9:** Recirculation; **DN10:** Sanitary expansion tank; **DN11:** Extra optional Magnesium Anode; **DN12:** Extra optional heating element;



CYLINDER



FOR SANITARY HOT WATER



SUITABLE FOR SOLAR SYSTEMS



MAGNESIUM ANODE



INTERNAL GLASSLINING
ANTI-CORROSION TREATMENT



POLYURETHANE INSULATION



HEAT EXCHANGER IN STAINLESS
STEEL AISI 304



HANDLING BY FORKLIFT



+ 95°C
WORKING TEMPERATURE



+110°C
HEAT EXCHANGER MAX
TEMPERATURE

P_{MAX} 6 bar
MAX WORKING PRESSURE

P_{SCA} 12 bar
HEAT EXCHANGER
MAX PRESSURE

WARRANTY: 5 YEARS

REFERENCE STANDARDS

CYLINDER:

2014/68/UE Directive - ART. 4.3, without CE marking
Ecodesign 2009/125/EC

INTERNAL GLASSLINING:

DIN 4753

The glasslining treatment makes the cylinder suitable to contain hot water for sanitary and hygienic use and resistant to corrosive phenomena.

INSULATION:

Expanded, flexible polyurethane with open cells.

HEAT EXCHANGER:

Removable U pipe stainless steel heat exchanger.


INSTALLATION:

- traditional boilers (wall-hung and/or floor-standing)
- condensing boilers
- solar thermal systems

MODEL	CODE	EXCHANGER							NOTES
		LOWER		CENTRAL					
		LITRES	m ²	LITRES	m ²	LITRES	mm	mm	
BF-2 / 1500	A370H67 VW050	1500	4,00	18	3,00	15	1100	2465	
BF-2 / 2000	A370H70 VW050	2000	4,00	18	4,00	18	1200	2445	
BF-2 / 3000	A370H74 VW050	3000	6,00	24	6,00	24	1350	2840	
BF-2 / 5000	A370H80 VW050	5000	10,00	39	10,00	39	1700	3045	

MODEL	ANODE ø x ø conn. x L	DN 1	DN 2	DN 3	DN 4	DN 5	DN 6	DN 7	DN 8	DN 9	DN 10	DN 11	DN 12
		BF-2 / 1500	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"
BF-2 / 2000	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/4"	2"
BF-2 / 3000	32 x 1.1/4" x 700	1.1/2"	1.1/2"	3"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/4"	2"
BF-2 / 5000	40 x 1.1/2" x 640	1.1/2"	1.1/2"	3"	3"	1.1/2"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/2"	2"

MODEL	A mm	B mm	C mm	D mm	E mm	F mm	G mm	I mm	L mm	M mm	N mm	O mm	P mm	Q mm	R mm	S mm	T mm	U mm	V mm
BF-2 / 1500	475	695	945	1295	1445	645	1245	1425	1545	-	80	530	755	-	1130	1355	-	-	2045
BF-2 / 2000	465	685	935	1285	1435	635	1235	1415	1535	-	80	520	745	-	1120	1345	-	-	2035
BF-2 / 3000	530	730	980	1480	1630	680	1280	1520	1730	-	80	565	790	-	1165	1390	-	-	2380
BF-2 / 5000	635	835	1085	1585	1735	785	1385	1625	1835	-	80	670	895	-	1270	1495	-	-	2485

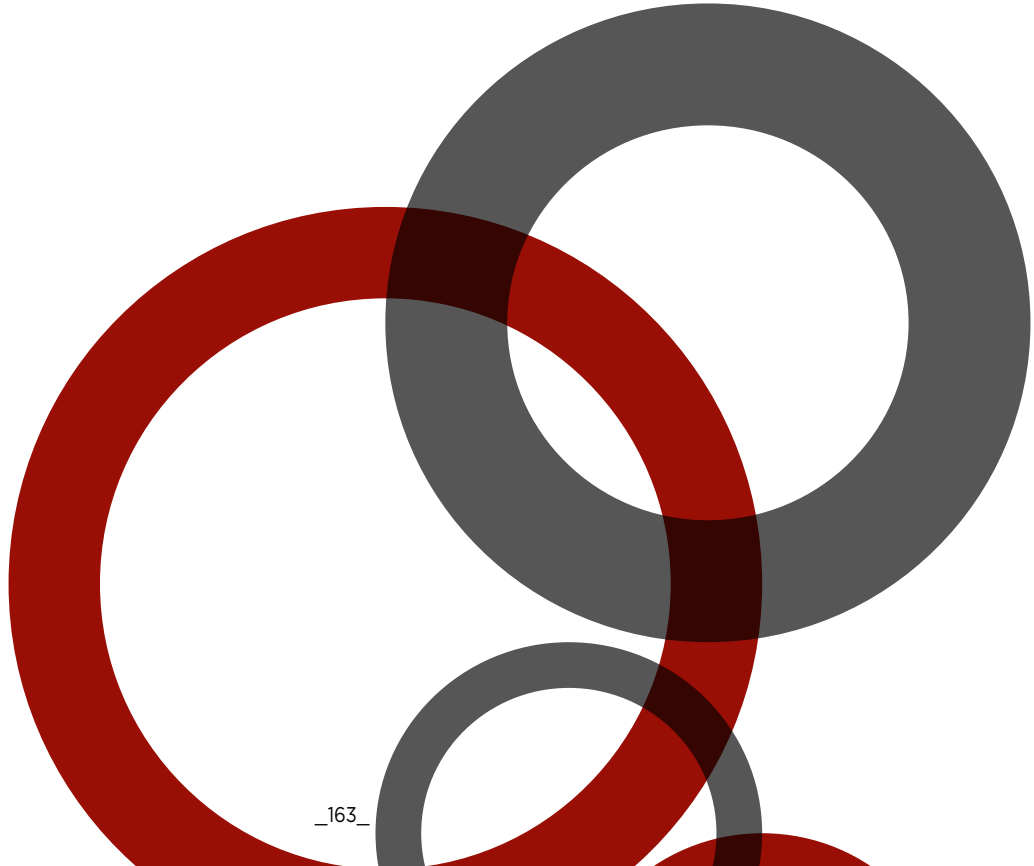

TECHNICAL CHARACTERISTICS

HEAT EXCHANGER	CODE	MAXIMUM WORKING PRESSURE / MAXIMUM WORKING TEMPERATURE			PRESSURE DROP OF HEAT EXCHANGERS
		HOT WATER 12 BAR / 110 °C	SATURATED STEAM 1 BAR / 120 °C	SATURATED STEAM 2 BAR / 134 °C	
3,0 m ²	2950300 V0010	•	•	•	200 mBar
4,0 m ²	2950400 V0010	•	•	•	220 mBar
6,0 m ²	2860600 V0010	•	•	•	350 mBar
10,0 m ²	2964000 V0010	•	•	n.a.	400 mBar

N.B. If using the heat exchanger with temperatures over 100 °C, ask for steam seals

MODEL	INSULATION TYPE	INSULATION THICKNESS	INSULATION DENSITY	INITIAL THERMAL CONDUCTIVITY	(*) INSULATION THERMAL LOSS	EXTERNAL FINISH
BF-2 / 1500	Flexible, expanded polyurethane with open cells	50 mm	15 kg/m ³	39 mW/m K	9,969 kWh / 24h	Skay white RAL 9001
BF-2 / 2000					10,865 kWh / 24h	
BF-2 / 3000					13,799 kWh / 24h	
BF-2 / 5000					18,264 kWh / 24h	

(*) Thermal loss calculated with an accumulation temperature equal to 65 °C and with an external temperature equal to 20 °C.

SAFETY DEVICES

The cylinders must be protected against the effects of over pressure by installing:

- A **SAFETY VALVE** calibrated to pressure below the max pressure of the cylinder
- A **SANITARY EXPANSION TANK** mod. ELBI **D - DV series**

MODEL	RECOMMENDED SANITARY EXPANSION TANK (mod. ELBI D-DV series)
BF-2 / 1500	DV - 150
BF-2 / 2000	DV - 150
BF-2 / 3000	DV - 300
BF-2 / 5000	n°2 pcs DV - 200

Sized using the following parameters: T. accumulation= 85 °C / T. inlet = 15 °C / Pre-charge pressure = 3 bar / Max pressure = 6 bar
The recommended capacity must be verified on the basis of the actual dimensions of the system implemented.


MODEL	MAGNESIUM ANODE SUPPLIED	CATHODIC PROTECTION APPLICABLE
BF-2 / 1500	1,1/4" x 670 / Cod.8560070	Cathodic protection for cylinders 1500/2000 l. Code 8560180
BF-2 / 2000	1,1/4" x 670 / Cod.8560070	
BF-2 / 3000	1,1/4" x 700 / Cod.8560080	Cathodic protection for cylinders 3000/5000 l. Code 8560185
BF-2 / 5000	1,1/2" x 640 / Cod.8560100	

ACCUMULATION AT 60 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 60°C

OPERATION WITH HOT WATER

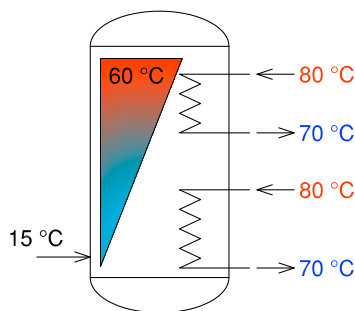

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]	Quantity DHW AT 45°C in first 10 min ⁽²⁾ [l]
BF-2 / 1500	3,0	72,00	6400	30	3203	1822
	4,0	98,00	8500			
BF-2 / 2000	4,0	98,00	8500	32	3656	2230
	4,0	98,00	8500			
BF-2 / 3000	6,0	159,30	14100	29	6088	3607
	6,0	159,30	14100			
BF-2 / 5000	10,0	250,70	22000	31	9580	5715
	10,0	250,70	22000			

(1) Time required to bring the temperature of the cylinder from 15 °C to 60 °C.


(2) Quantity of DHW (Sanitary Hot Water) at 45°C available in the first 10 minutes with DHW accumulation at 60° C.

ACCUMULATION AT 45 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 45°C

OPERATION WITH HOT WATER

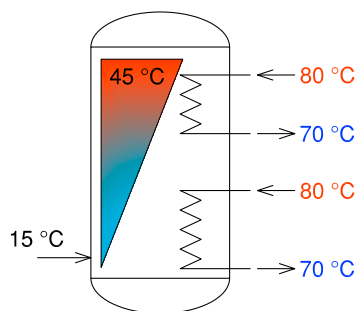

MODEL	HEAT EXCHANGER [m ²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 45°C [l/hour]
BF-2 / 1500	3,0	92,00/	8100	16	6135
	4,0	131,60	11600		
BF-2 / 2000	4,0	131,60	11600/	16	7540
	4,0	131,60	11600		
BF-2 / 3000	6,0	223,60	19710	14	12820
	6,0	223,60	19710		
BF-2 / 5000	10,0	339,00	29900	16	19440
	10,0	339,00	29900		



(1) Time required to bring the temperature of the cylinder from 15 °C to 45 °C

TABLE OF HEATING ELEMENT APPLICABILITY TO CYLINDERS

Heating element model					Water heating time from 15° C to 60 °C (expressed in minutes) <i>The heating times outlined are approximate</i>			
CODE	Power (kW)	Voltage (Volt)	Connection	Length (mm)	BF-2 1500	BF-2 2000	BF-2 3000	BF-2 5000
8601000	1	220 V / MF	G 1.1/4"	295	4720 min.	6300 min.	9420 min.	15750 min.
8601650	1.65	220 V / MF	G 1.1/4"	450	2870 min.	3820 min.	5740 min.	9550 min.
8602000	2	220 V / MF	G 1.1/4"	515	2370 min.	3150 min.	4740 min.	7875 min.
8602600	2.6	220 V / MF	G 1.1/4"	675	1830 min.	2450 min.	3660 min.	6125 min.
8602601	2.6	220 V / MF	G 1.1/4"	360	1830 min.	2450 min.	3660 min.	6125 min.
8603300	3.3	220 V / MF	G 1.1/4"	825	1450 min.	1940 min.	2900 min.	4850 min.
8603301	3.3	220 V / MF	G 1.1/4"	435	1450 min.	1940 min.	2900 min.	4850 min.
8604001	4	220 V / MF	G 1.1/4"	510	1200 min.	1600 min.	2400 min.	4000 min.
8705000	5	380 V / TF	G 1.1/2"	445	950 min.	1300 min.	1900 min.	3250 min.
8706000	6	380 V / TF	G 1.1/2"	510	800 min.	1060 min.	1600 min.	2650 min.
8708000	8	380 V / TF	G 1.1/2"	670	610 min.	800 min.	1220 min.	2000 min.
8710000	10	380 V / TF	G 1.1/2"	820	490 min.	640 min.	980 min.	1600 min.
8712000	12	380 V / TF	G 1.1/2"	970	410 min.	540 min.	820 min.	1350 min.

n.a. =Heating element not applicable

SEE TABLE OF SYMBOLS
IN THE SHUTTER OF THE
COVER

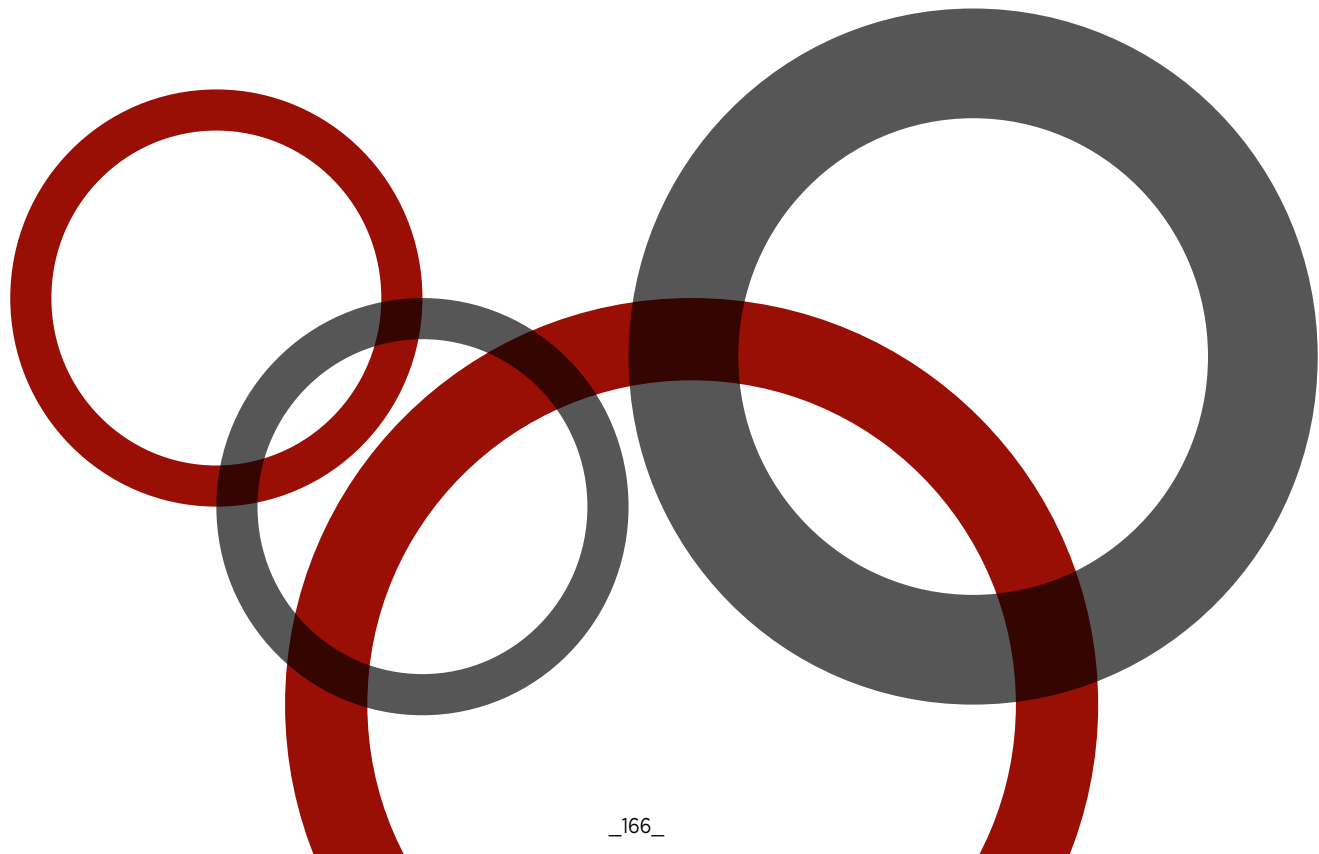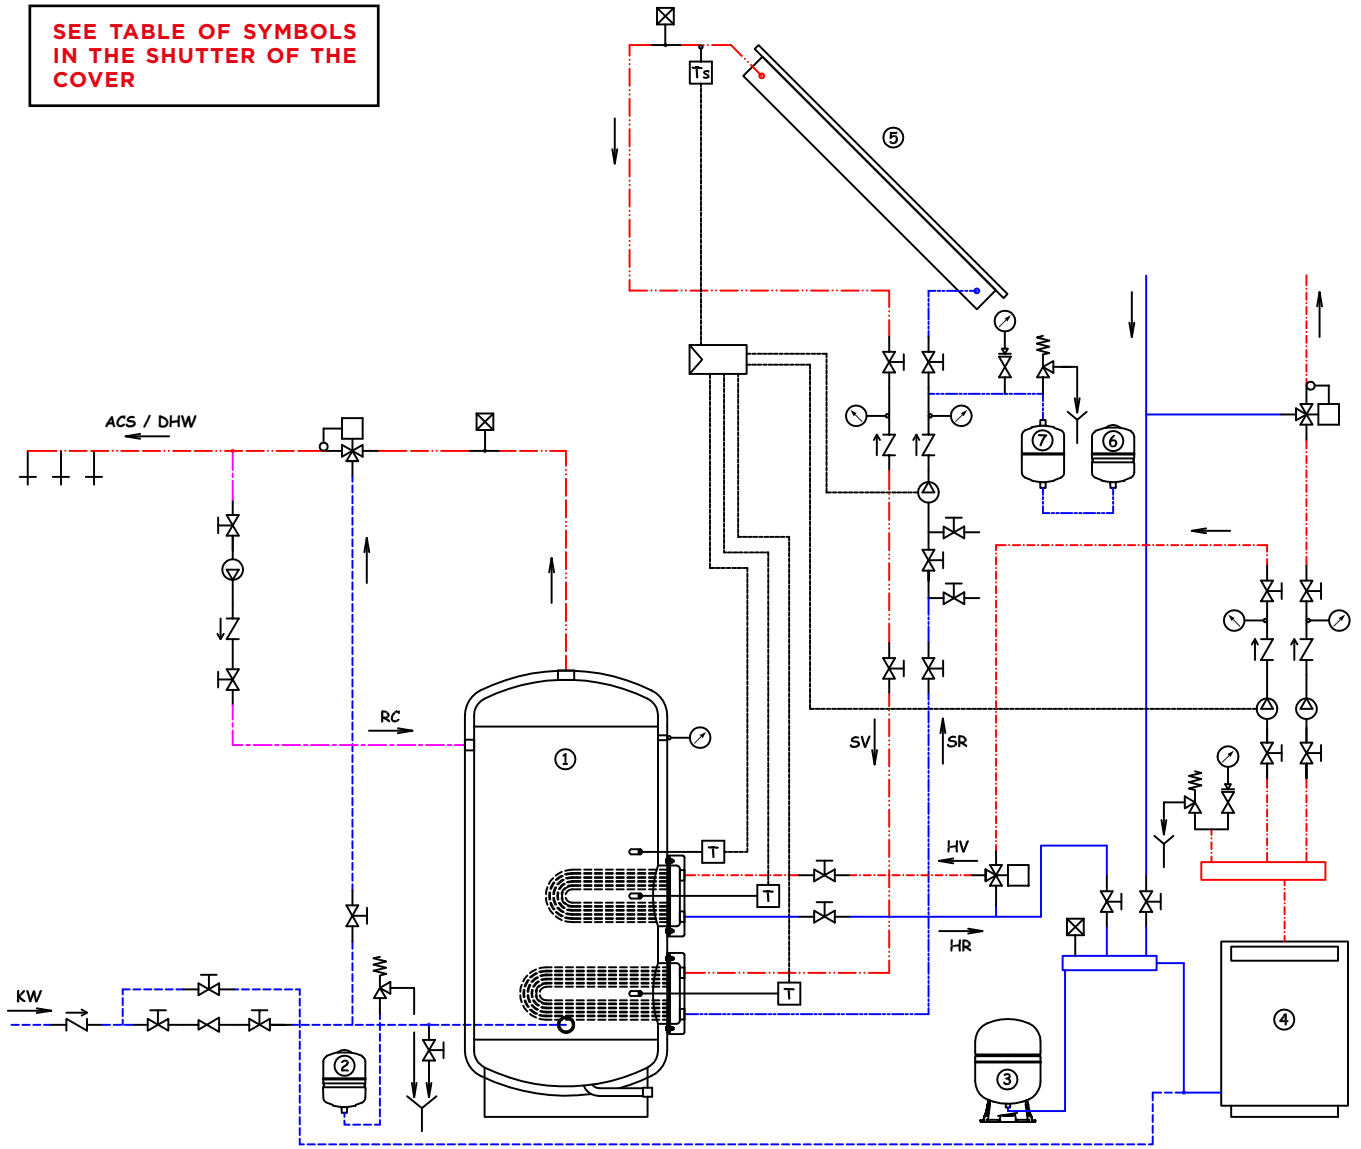




BF3

GLASSLINED CYLINDERS

WITH THREE REMOVABLE STAINLESS STEEL HEAT EXCHANGERS (1.500 - 5.000 LITRES)



BF3 1500 - 2000 - 3000 - 5000

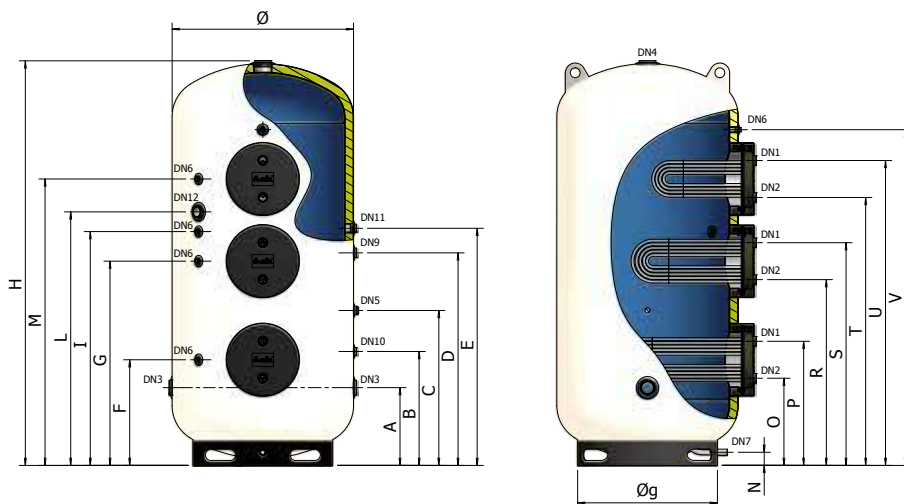

KEYWORD

DN1: Primary fluid inlet (heat exchanger side); **DN2:** Primary fluid outlet (heat exchanger side); **DN3:** Sanitary cold water inlet; **DN4:** Sanitary hot water outlet; **DN5:** Magnesium anode; **DN6:** Probes; **DN7:** Tank drain; **DN8:** Thermo-regulation; **DN9:** Recirculation; **DN10:** Sanitary expansion tank; **DN11:** Extra optional Magnesium Anode; **DN12:** Extra optional heating element;

CYLINDER

FOR SANITARY HOT WATER

SUITABLE FOR SOLAR SYSTEMS

MAGNESIUM ANODE

INTERNAL, GLASSLINING ANTI-CORROSION TREATMENT

POLYURETHANE INSULATION

HEAT EXCHANGER IN STAINLESS STEEL AISI 304

HANDLING BY FORKLIFT

+ 95°C WORKING TEMPERATURE

+110°C HEAT EXCHANGER MAX TEMPERATURE

P_{MAX} 6 bar MAX WORKING PRESSURE

P_{SCA} 12 bar HEAT EXCHANGER MAX PRESSURE

WARRANTY: 5 YEARS

REFERENCE STANDARDS

CYLINDER:

2014/68/UE Directive - ART. 4.3, without CE marking
Ecodesign 2009/125/EC

INTERNAL GLASSLINING:

DIN 4753

The glasslining treatment makes the cylinder suitable to contain hot water for sanitary and hygienic use and resistant to corrosive phenomena.

INSULATION:

Expanded, flexible polyurethane with open cells.

HEAT EXCHANGER:

Removable U pipe stainless steel heat exchanger.

INSTALLATION:

- traditional boilers (wall-hung and/or floor-standing)
- condensing boilers
- solar thermal systems

MODEL	CODE	LITRES	EXCHANGER						mm	mm	NOTES
			LOWER		CENTRAL		UPPER				
			m ²	LITRES	m ²	LITRES	m ²	LITRES			
BF-3 / 1500	A380H67 VW050	1500	4,00	18	3,00	15	1,60	7,5	1100	2465	
BF-3 / 2000	A380H70 VW050	2000	4,00	18	4,00	18	2,50	12,5	1200	2445	
BF-3 / 3000	A380H74 VW050	3000	6,00	24	6,00	24	3,00	15	1350	2840	
BF-3 / 5000	A380H80 VW050	5000	10,00	39	10,00	39	5,00	21	1700	3045	

MODEL	ANODE ø x ø conn. x L	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN	DN
		1	2	3	4	5	6	7	8	9	10	11	12
BF-3 / 1500	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/4"	2"
BF-3 / 2000	32 x 1.1/4" x 670	1.1/2"	1.1/2"	2.1/2"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/4"	2"
BF-3 / 3000	32 x 1.1/4" x 700	1.1/2"	1.1/2"	3"	3"	1.1/4"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/4"	2"
BF-3 / 5000	40 x 1.1/2" x 640	1.1/2"	1.1/2"	3"	3"	1.1/2"	1/2"	1"	-	1.1/2"	1.1/4"	1.1/2"	2"

MODEL	A	B	C	D	E	F	G	I	L	M	N	O	P	Q	R	S	T	U	V
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
BF-3 / 1500	475	695	945	1295	1445	645	1245	1425	1545	1745	80	530	755	-	1130	1355	1630	1855	2045
BF-3 / 2000	465	685	935	1285	1435	635	1235	1415	1535	1735	80	520	745	-	1120	1345	1620	1845	2035
BF-3 / 3000	530	730	980	1480	1630	680	1280	1520	1730	1930	80	565	790	-	1165	1390	1815	2040	2380
BF-3 / 5000	635	835	1085	1585	1735	785	1385	1625	1835	2035	80	670	895	-	1270	1495	1920	2145	2485

TECHNICAL CHARACTERISTICS

HEAT EXCHANGER	CODE	MAXIMUM WORKING PRESSURE / MAXIMUM WORKING TEMPERATURE				PRESSURE DROP OF HEAT EXCHANGERS
		HOT WATER 12 BAR / 110 °C	SATURATED STEAM 1 BAR / 120 °C	SATURATED STEAM 2 BAR / 134 °C	SATURATED STEAM 4 BAR / 152 °C	
1,6 m ²	2950150 V0010	●	●	●	●	80 mBar
2,5 m ²	2960250 V0010	●	●	●	●	110 mBar
3,0 m ²	2950300 V0010	●	●	●	n.a.	200 mBar
4,0 m ²	2950400 V0010	●	●	●	n.a.	220 mBar
5,0 m ²	2960500 V0010	●	●	●	n.a.	270 mBar
6,0 m ²	2960600 V0010	●	●	●	n.a.	350 mBar
10,0 m ²	2961000 V0010	●	●	n.a.	n.a.	400 mBar

N.B. If using the heat exchanger with temperatures over 100 °C, ask for steam seals

MODEL	INSULATION TYPE	INSULATION THICKNESS	INSULATION DENSITY	INITIAL THERMAL CONDUCTIVITY	(*) INSULATION THERMAL LOSS	EXTERNAL FINISH
BF-3 / 1500	Flexible, expanded polyurethane with open cells	50 mm	15 kg/m ³	39 mW/m K	9,969 kWh / 24h	Skay white RAL 9001
BF-3 / 2000					10,865 kWh / 24h	
BF-3 / 3000					13,799 kWh / 24h	
BF-3 / 5000					18,264 kWh / 24h	

(*) Thermal loss calculated with an accumulation temperature equal to 65 °C and with an external temperature equal to 20 °C.

SAFETY DEVICES

The cylinders must be protected against the effects of over pressure by installing:

- A **SAFETY VALVE** calibrated to pressure below the max pressure of the cylinder
- A **SANITARY EXPANSION TANK** mod. ELBI **D - DV series**

MODEL	RECOMMENDED SANITARY EXPANSION TANK (mod. ELBI D-DV series)
BF-3 / 1500	DV - 150
BF-3 / 2000	DV - 150
BF-3 / 3000	DV - 300
BF-3 / 5000	n°2 pcs DV - 200

Sized using the following parameters: T. accumulation= 85 °C / T. inlet = 15 °C / Pre-charge pressure = 3 bar / Max pressure = 6 bar
The recommended capacity must be verified on the basis of the actual dimensions of the system implemented


MODEL	MAGNESIUM ANODE SUPPLIED	CATHODIC PROTECTION APPLICABLE
BF-3 / 1500	1,1/4" x 670 / Cod.8560070	Cathodic protection for cylinders 1500/2000 l Code 8560180
BF-3 / 2000	1,1/4" x 670 / Cod.8560070	
BF-3 / 3000	1,1/4" x 700 / Cod.8560080	Cathodic protection for cylinders 3000/5000 l. Code 8560185
BF-3 / 5000	1,1/2" x 640 / Cod.8560100	

ACCUMULATION AT 60 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 60°C

OPERATION WITH HOT WATER

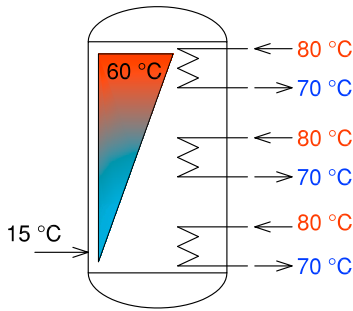

MODEL	HEAT EXCHANGER [m²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 60°C [l/hour]	QUANTITY DHW AT 45°C in first 10 min. ⁽²⁾ [l]
BF-3 / 1500	1,6	40,60	3580	42	775	1084
	3,0	72,00	6400			
	4,0	98,00	8500	30	3203	1825
BF-3 / 2000	2,5	54,00	4760	38	1030	1362
	4,0	98,00	8500			
	4,0	98,00	8500	32	3656	2220
BF-3 / 3000	3,0	72,00	6400	46	1375	1895
	6,0	159,30	14100			
	6,0	159,30	14100	29	6088	3592
BF-3 / 5000	5,0	115,00	10150	47	2197	3228
	10,0	250,70	22000			
	10,0	250,70	22000	31	9580	5705

(1) Time required to bring the temperature of the cylinder from 15 °C to 60 °C.


(2) Quantity of DHW (Sanitary Hot Water) at 45°C available in the first 10 minutes with DHW accumulation at 60° C.

ACCUMULATION AT 45 °C

HEAT EXCHANGER: T.inlet = 80°C; ΔT = 10°C.

STORAGE WATER HEATER: T.inlet =15°C; T. accumulation = 45°C

OPERATION WITH HOT WATER

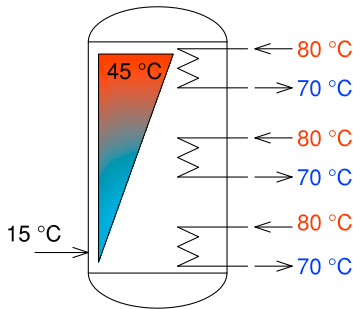

MODEL	HEAT EXCHANGER [m²]	THERMAL POWER [kW]	PUMP CAPACITY [l/hour]	HEATING TIME ⁽¹⁾ [min]	PRODUCTION DHW AT 45°C [l/hour]
BF-3 / 1500	1,6	59,20	5230	20	1690
	3,0	92,00	8100		
	4,0	131,60	11600	16	6135
BF-3 / 2000	2,5	78,00	6900	18	2230
	4,0	131,60	11600		
	4,0	131,60	11600	16	7540
BF-3 / 3000	3,0	91,90	8140	24	2635
	6,0	223,60	19710		
	6,0	223,60	19710	14	12820
BF-3 / 5000	5,0	160,00	14000	23	4580
	10,0	339,00	29900		
	10,0	339,00	29900	16	19440

(1) Time required to bring the temperature of the cylinder from 15 °C to 45 °C.

TABLE OF HEATING ELEMENT APPLICABILITY TO CYLINDERS

Heating element model*					Water heating time from 15° C to 60 °C (expressed in minutes) <i>The heating times outlined are approximate</i>			
CODE	Power (kW)	Voltage (Volt)	Connection	Length (mm)	BF-3 1500	BF-3 2000	BF-3 3000	BF-3 5000
8601000	1	220 V / MF	G 1.1/4"	295	4720 min.	6300 min.	9420 min.	15750 min.
8601650	1.65	220 V / MF	G 1.1/4"	450	2870 min.	3820 min.	5740 min.	9550 min.
8602000	2	220 V / MF	G 1.1/4"	515	2370 min.	3150 min.	4740 min.	7875 min.
8602600	2.6	220 V / MF	G 1.1/4"	675	1830 min.	2450 min.	3660 min.	6125 min.
8602601	2.6	220 V / MF	G 1.1/4"	360	1830 min.	2450 min.	3660 min.	6125 min.
8603300	3.3	220 V / MF	G 1.1/4"	825	1450 min.	1940 min.	2900 min.	4850 min.
8603301	3.3	220 V / MF	G 1.1/4"	435	1450 min.	1940 min.	2900 min.	4850 min.
8604001	4	220 V / MF	G 1.1/4"	510	1200 min.	1600 min.	2400 min.	4000 min.
8705000	5	380 V / TF	G 1.1/2"	445	950 min.	1300 min.	1900 min.	3250 min.
8706000	6	380 V / TF	G 1.1/2"	510	800 min.	1060 min.	1600 min.	2650 min.
8708000	8	380 V / TF	G 1.1/2"	670	610 min.	800 min.	1220 min.	2000 min.
8710000	10	380 V / TF	G 1.1/2"	820	490 min.	640 min.	980 min.	1600 min.
8712000	12	380 V / TF	G 1.1/2"	970	410 min.	540 min.	820 min.	1350 min.

n.a. =Heating element not applicable

SEE TABLE OF SYMBOLS
IN THE SHUTTER OF THE
COVER

