

Pressure relief controller
AFA / VFG 2, VFG 21 DN 15 - 250



Valves

Valves VFG 2 (metallic sealing cone)

	DN mm	k _{vs} m ³ /h	t _{max.} °C		Code No.		
					PN 16	PN 25	PN 40
	15	4.0	150	200*	065B2388	065B2401	065B2411
	20	6.3	150	200*	065B2389	065B2402	065B2412
	25	8.0	150	200*	065B2390	065B2403	065B2413
	32	16	150	200*	065B2391	065B2404	065B2414
	40	20	150	200*	065B2392	065B2405	065B2415
	50	32	150	200*	065B2393	065B2406	065B2416
	65	50	150	200*	065B2394	065B2407	065B2417
	80	80	150	200*	065B2395	065B2408	065B2418
	100	125	150	200*	065B2396	065B2409	065B2419
	125	160	150	200*	065B2397	065B2410	065B2420
	150	280	140	-	065B2398	-	065B2421
	200	320	140	-	065B2399	-	065B2422
	250	400	140	-	065B2400	-	065B2423
	150	280	-	200*	on request		
	200	320	-	200*			
	250	400	-	200*			

* temperatures up to 200 °C only with seal pot, mounted in the impulse tube to the flow


Valves VFG 21 (soft sealing cone)

	DN mm	k _{vs} m ³ /h	t _{max.} °C		Code No.		
					PN 16	PN 25	PN 40
	15	4.0	150		065B2502	065B2515	065B2525
	20	6.3	150		065B2503	065B2516	065B2526
	25	8.0	150		065B2504	065B2517	065B2527
	32	16	150		065B2505	065B2518	065B2528
	40	20	150		065B2506	065B2519	065B2529
	50	32	150		065B2507	065B2520	065B2530
	65	50	150		065B2508	065B2521	065B2531
	80	80	150		065B2509	065B2522	065B2532
	100	125	150		065B2510	065B2523	065B2533
	125	160	150		065B2511	065B2524	065B2534
	150	280	140		065B2512	-	065B2535
	200	320	140		065B2513	-	065B2536
	250	400	140		065B2514	-	065B2537

Actuators


AFA Actuators

	Diff. pressure (bar)	For DN	Code No.
	10 - 16	15 - 125	003G1007
	3 - 11		003G1008
	1 - 5	15 - 250	003G1009
	0.5 - 2.5		003G1010
	0.15 - 1.2		003G1011
	0.1 - 0.6		003G1012
	0.05 - 0.35 (630 cm ²)		003G1013

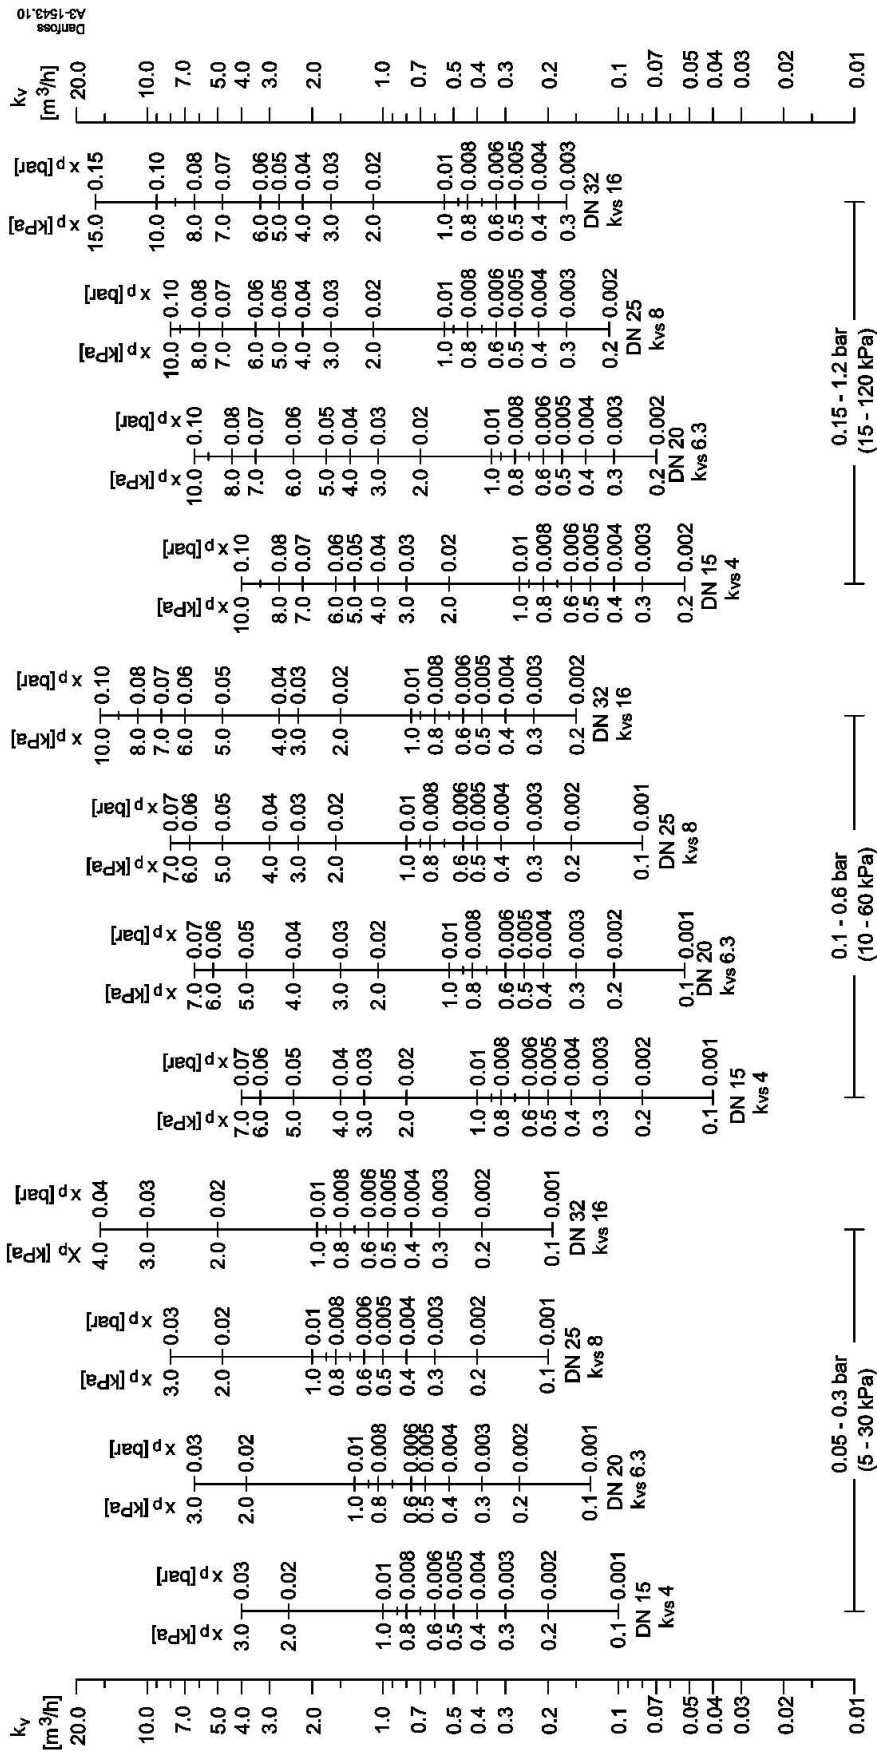


After selecting the suitable valve size, corresponding P-band (Xp) can be read out from above graphs. It is recommended that Xp does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

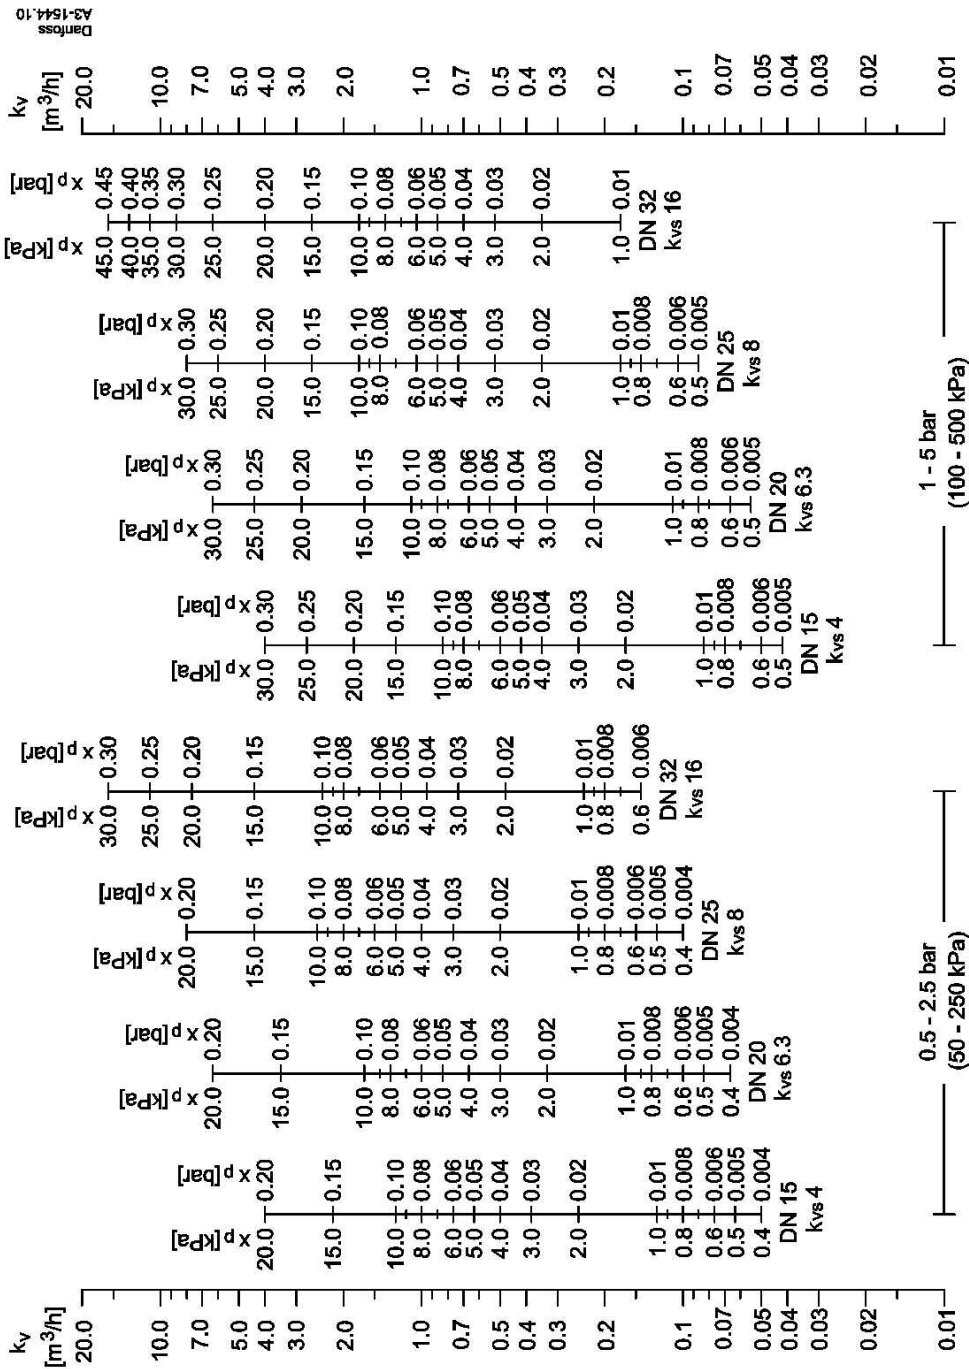


After selecting the suitable valve size, corresponding P-band (X_p) can be read out from above graphs. It is recommended that X_p does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

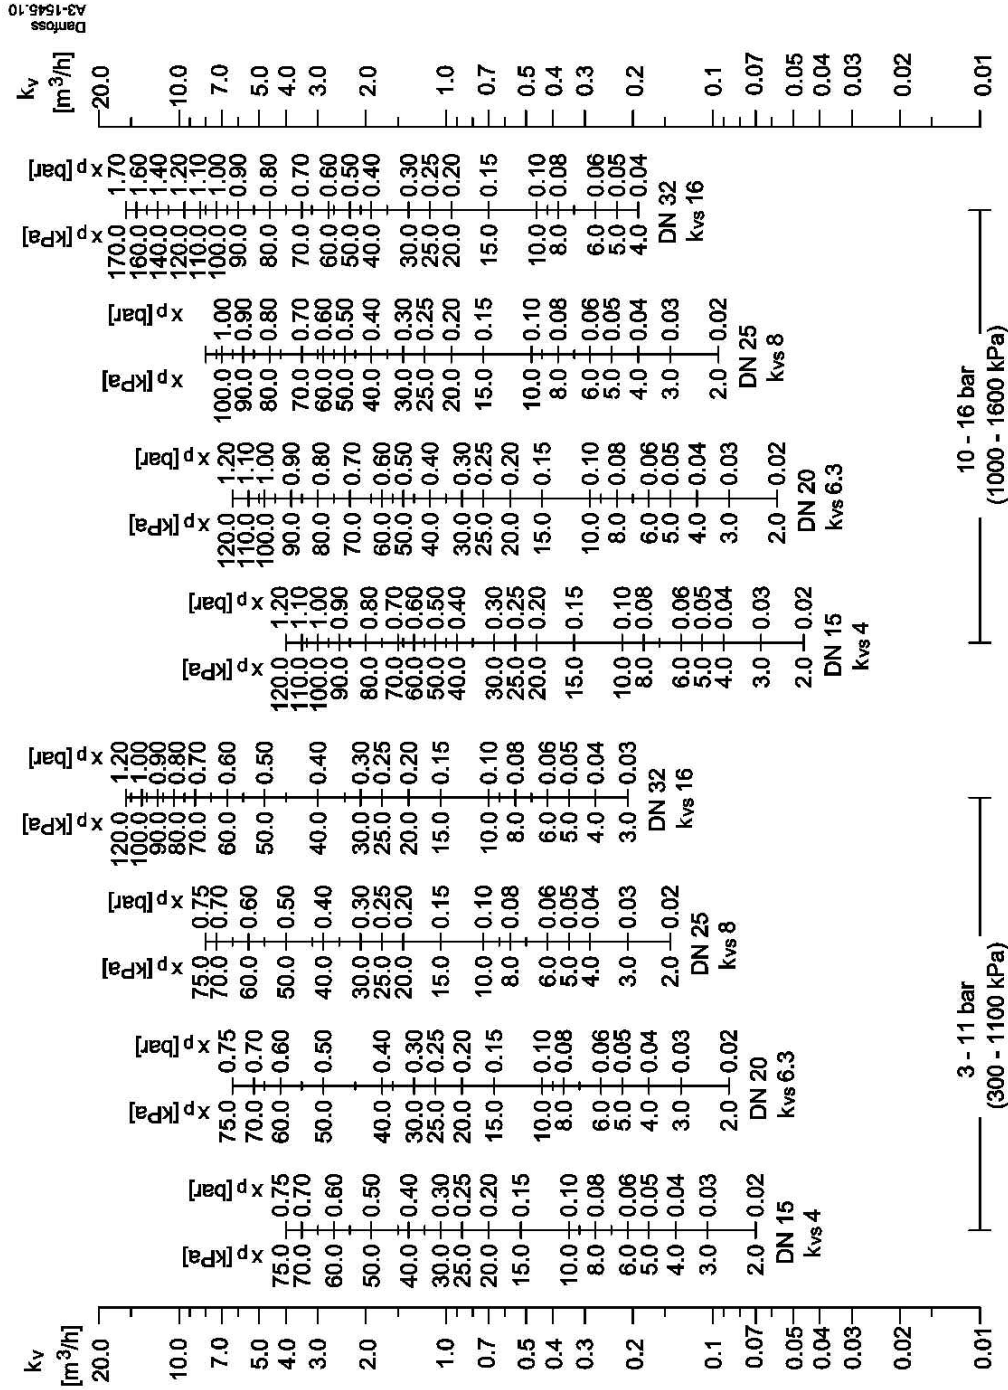


After selecting the suitable valve size, corresponding P-band (X_p) can be read out from above graphs. It is recommended that X_p does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

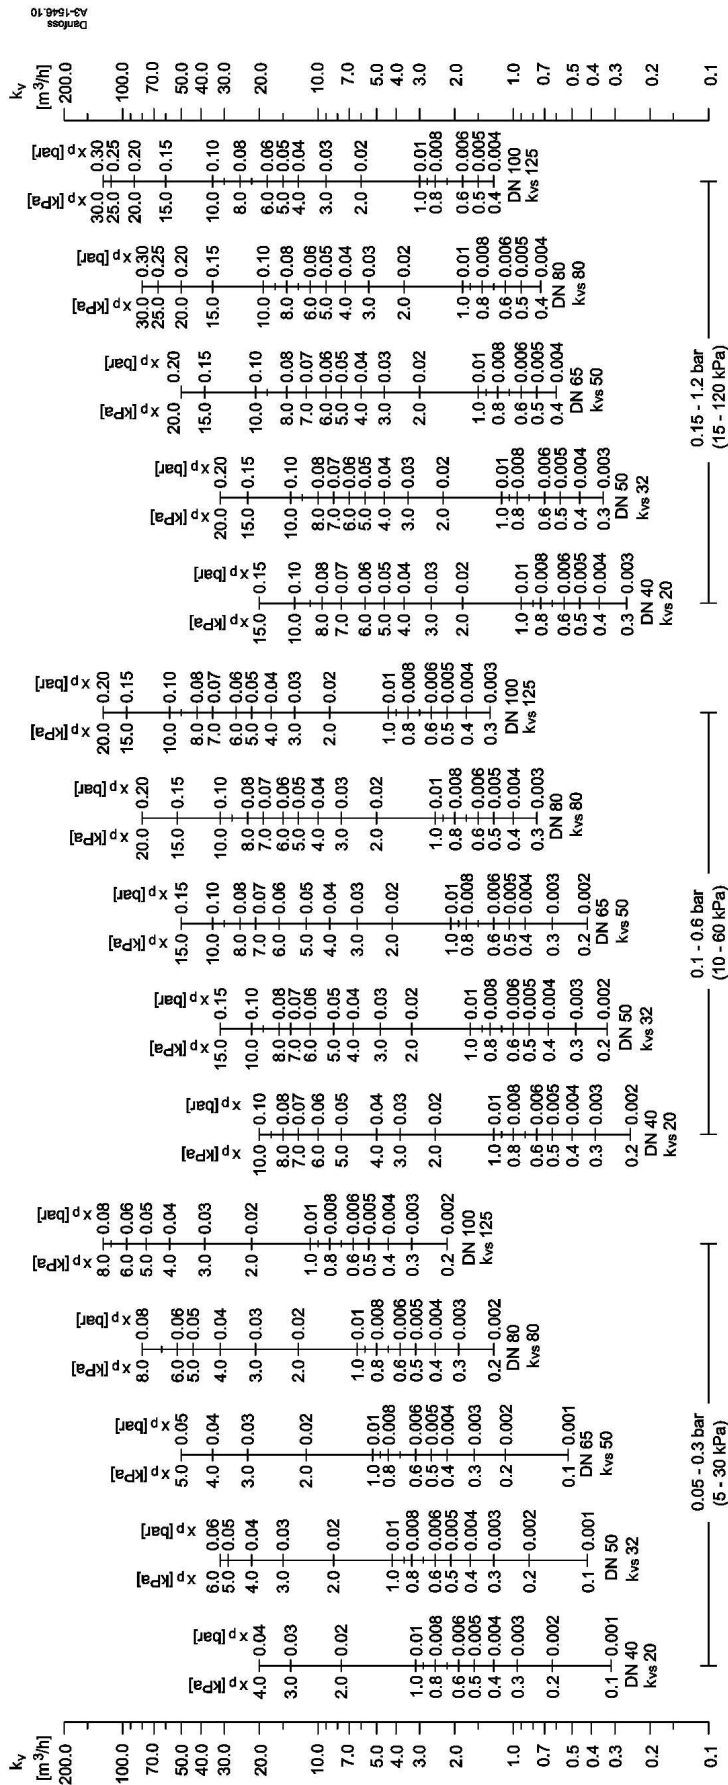


After selecting the suitable valve size, corresponding P-band (Xp) can be read out from above graphs. It is recommended that Xp does not exceed 50% of the required set-point. Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

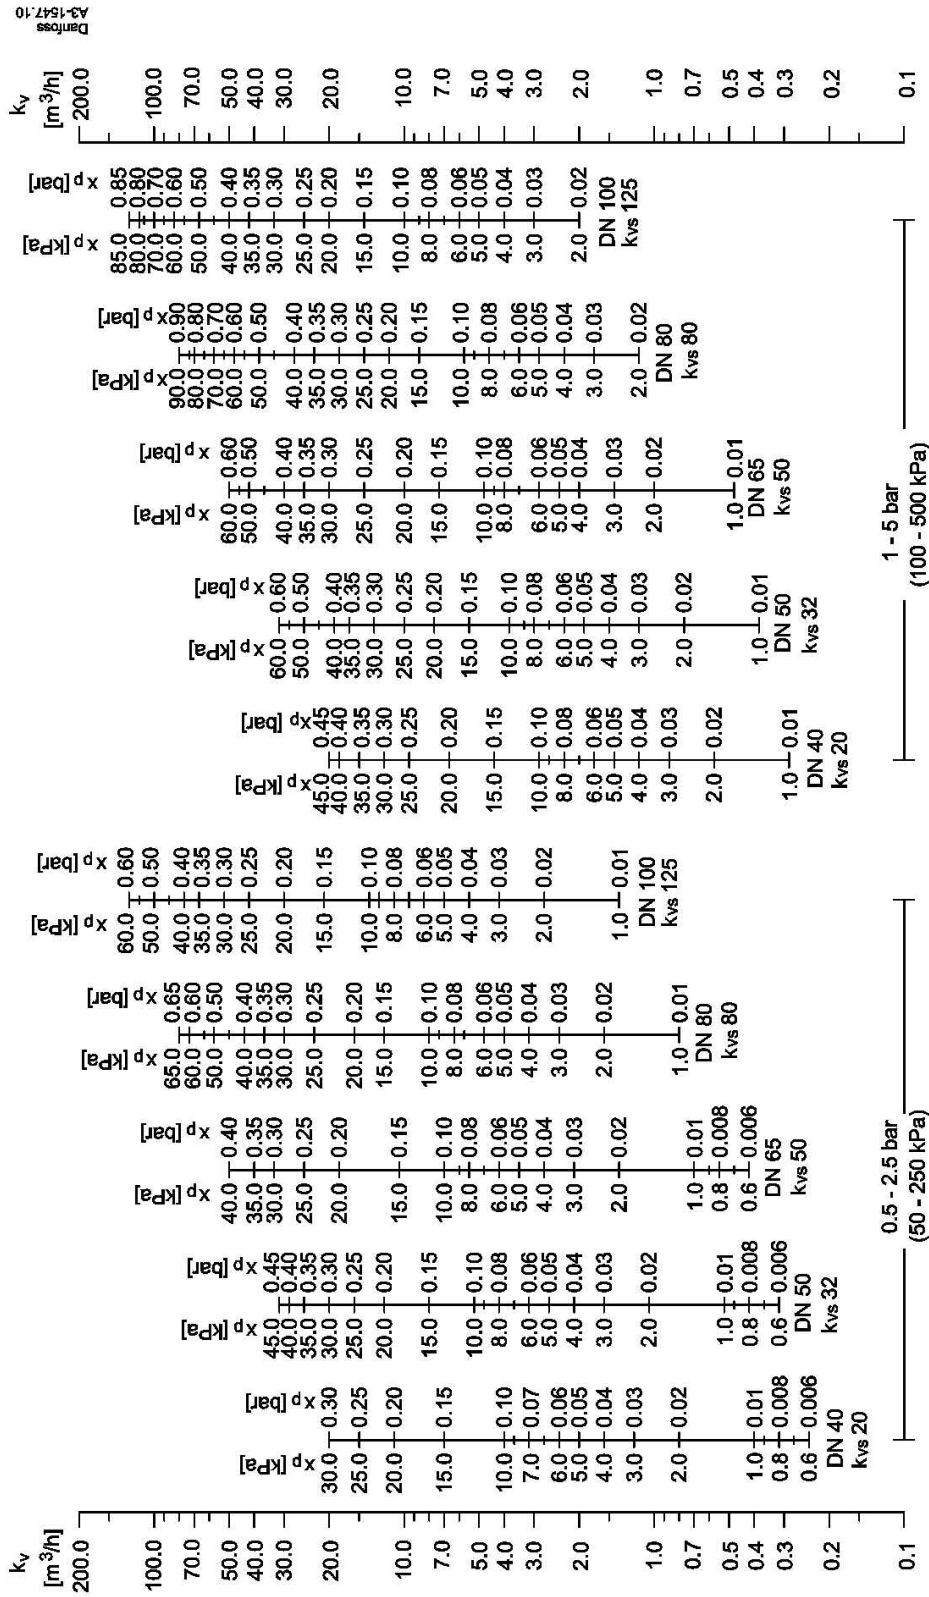


After selecting the suitable valve size, corresponding P-band (X_p) can be read out from above graphs. It is recommended that X_p does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

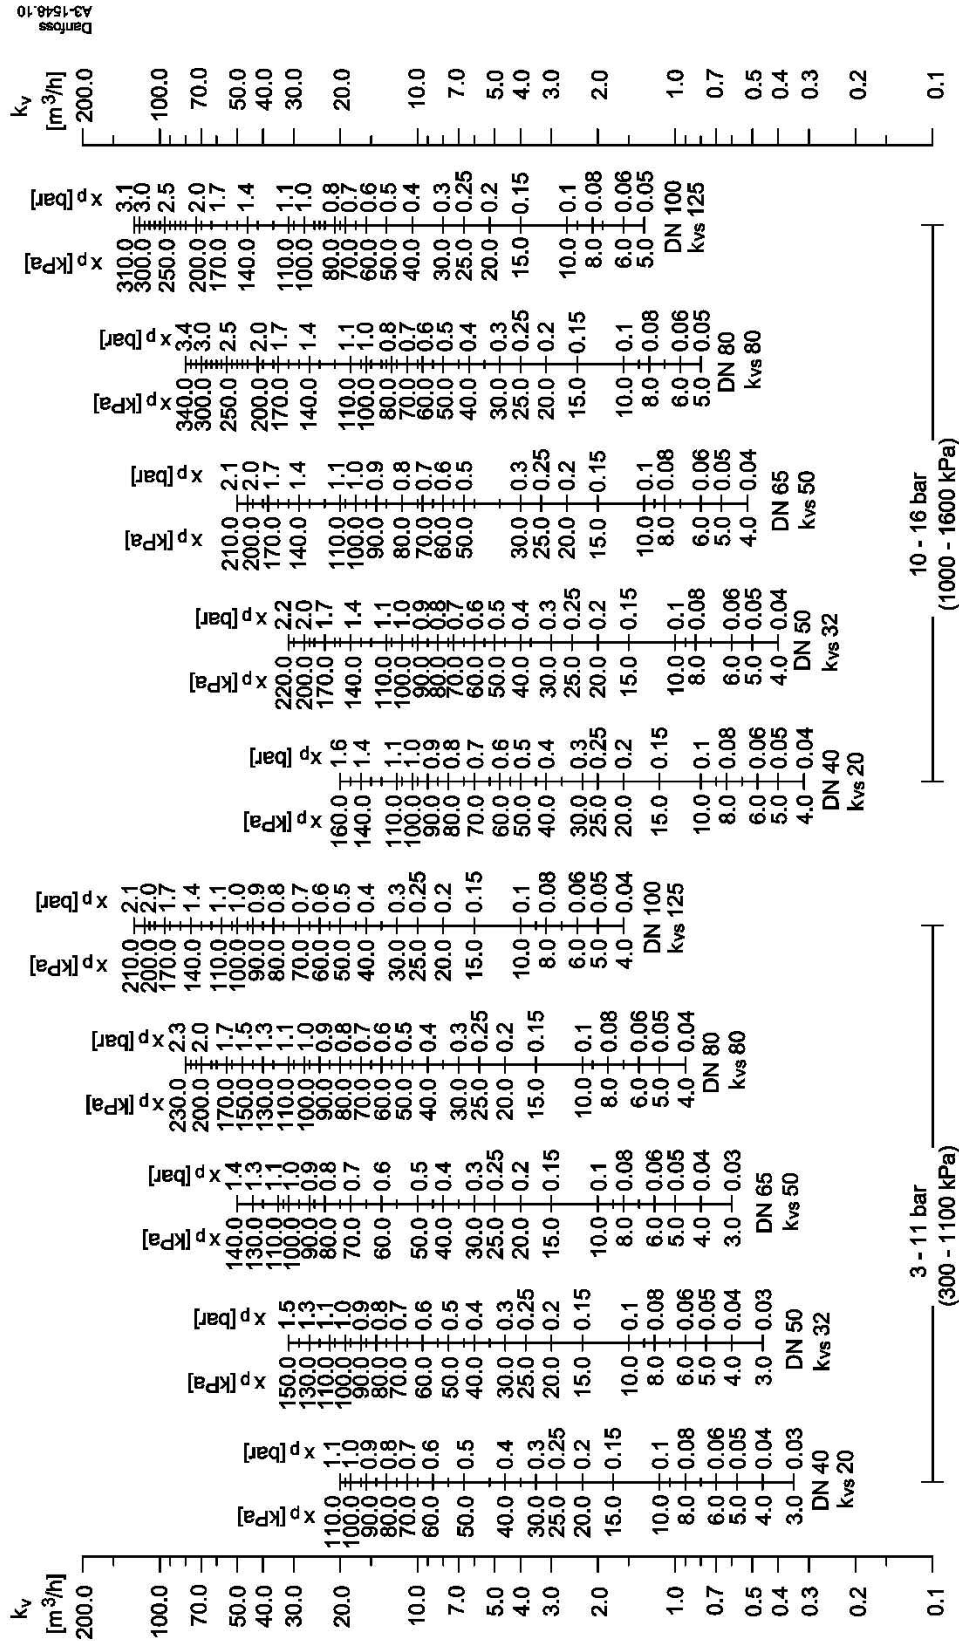


After selecting the suitable valve size, corresponding P-band (X_p) can be read out from above graphs. It is recommended that X_p does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

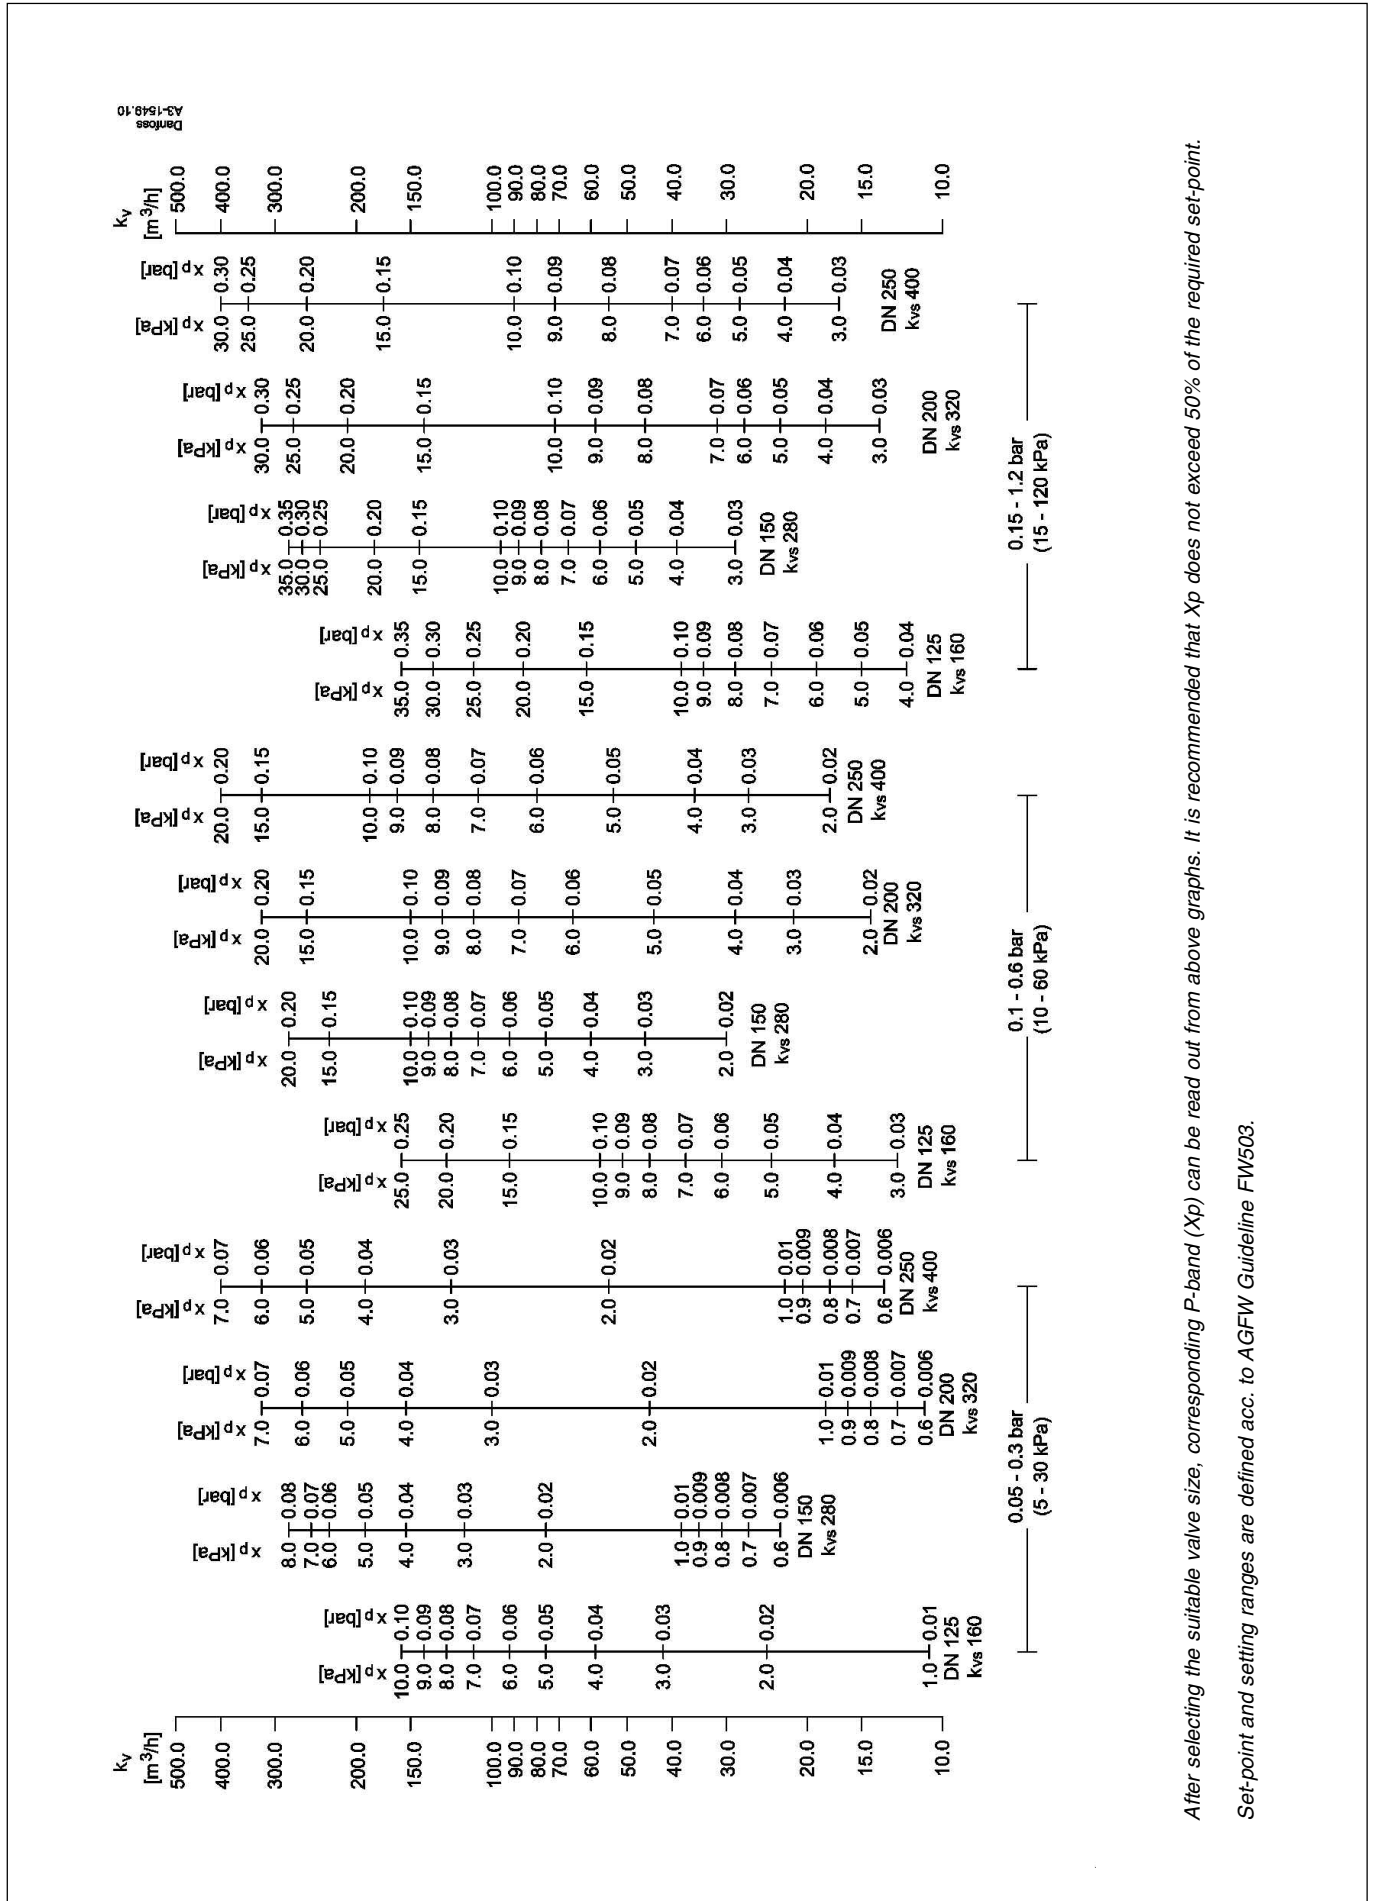

After selecting the suitable valve size, corresponding P-band (X_p) can be read out from above graphs. It is recommended that X_p does not exceed 50% of the required set-point.

Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

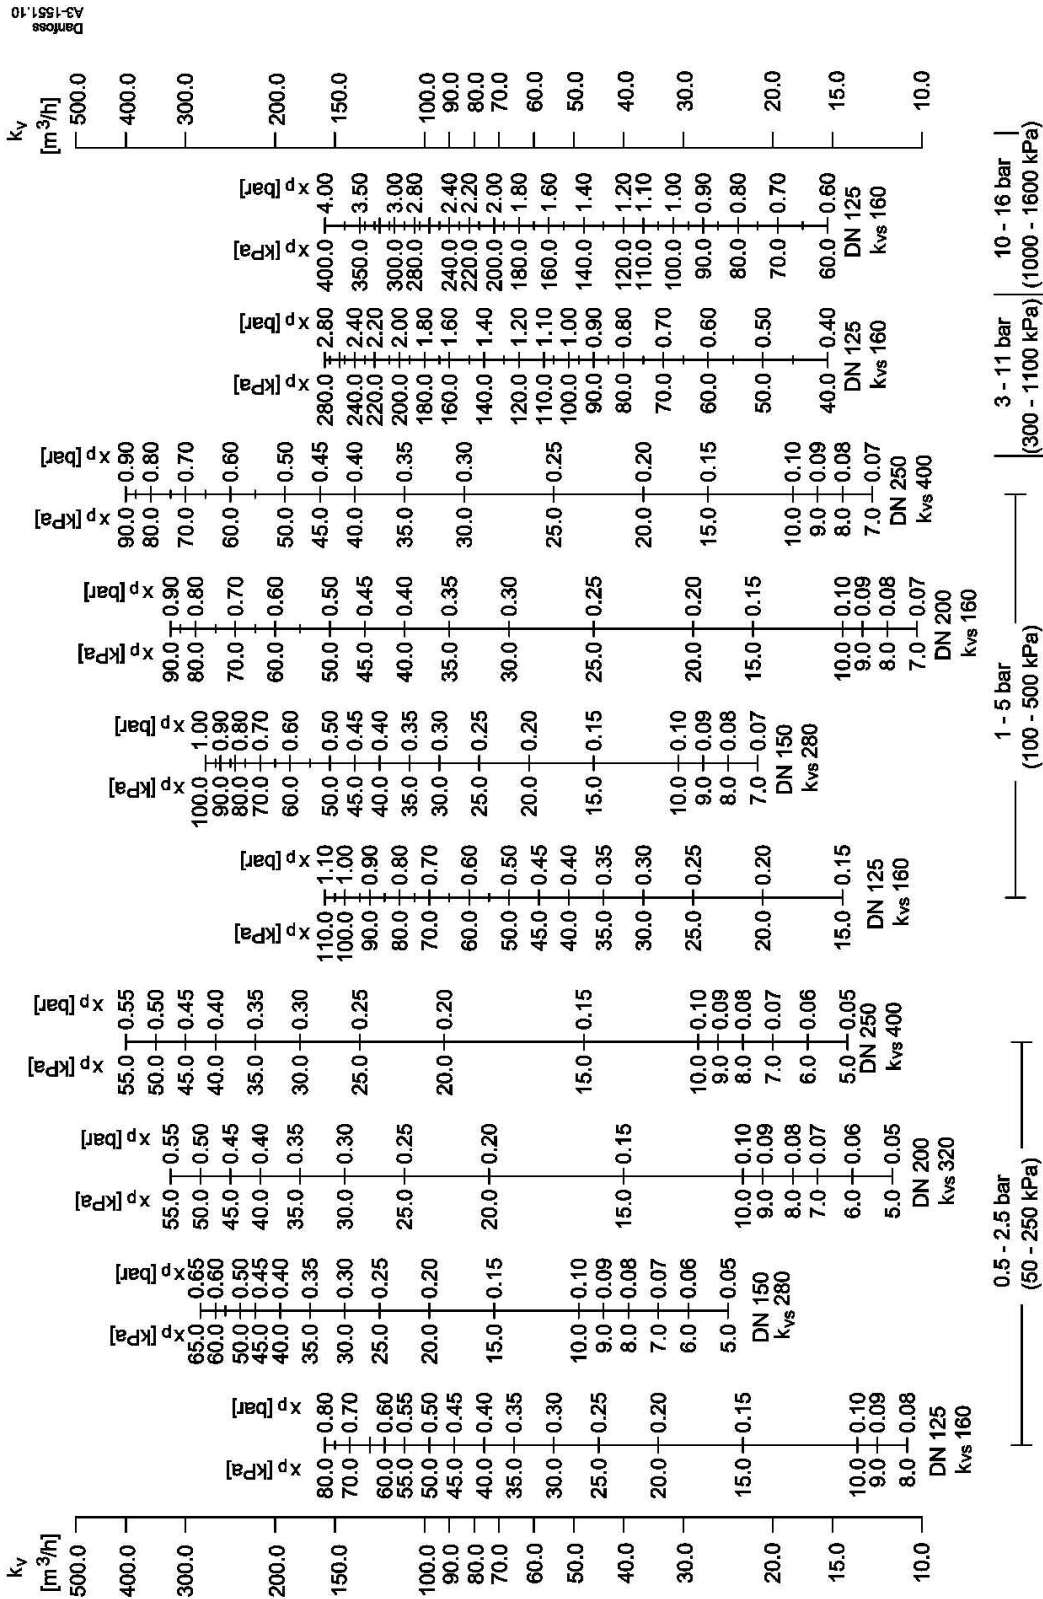

After selecting the suitable valve size, corresponding P-band (Xp) can be read out from above graphs. It is recommended that Xp does not exceed 50% of the required set-point. Set-point and setting ranges are defined acc. to AGFW Guideline FW503.

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed.
All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

